



\\slr-local\au\Offices\UK Glasgow\Projects\Projects\106740 - Brockwell Energy Limited\413.057968-SLR-XX-XX-F-PA-0002.5_Typical Cable Trench.dwg 10/09/2026

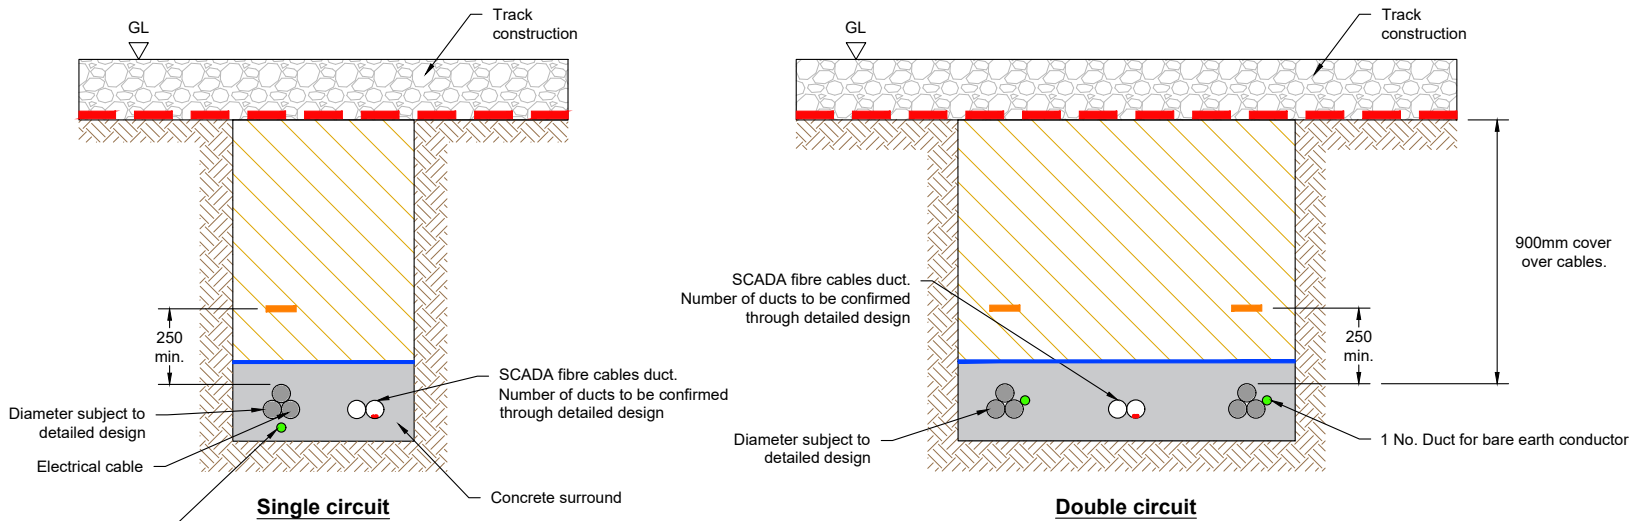

Indicative section through track crossing typical cable trench

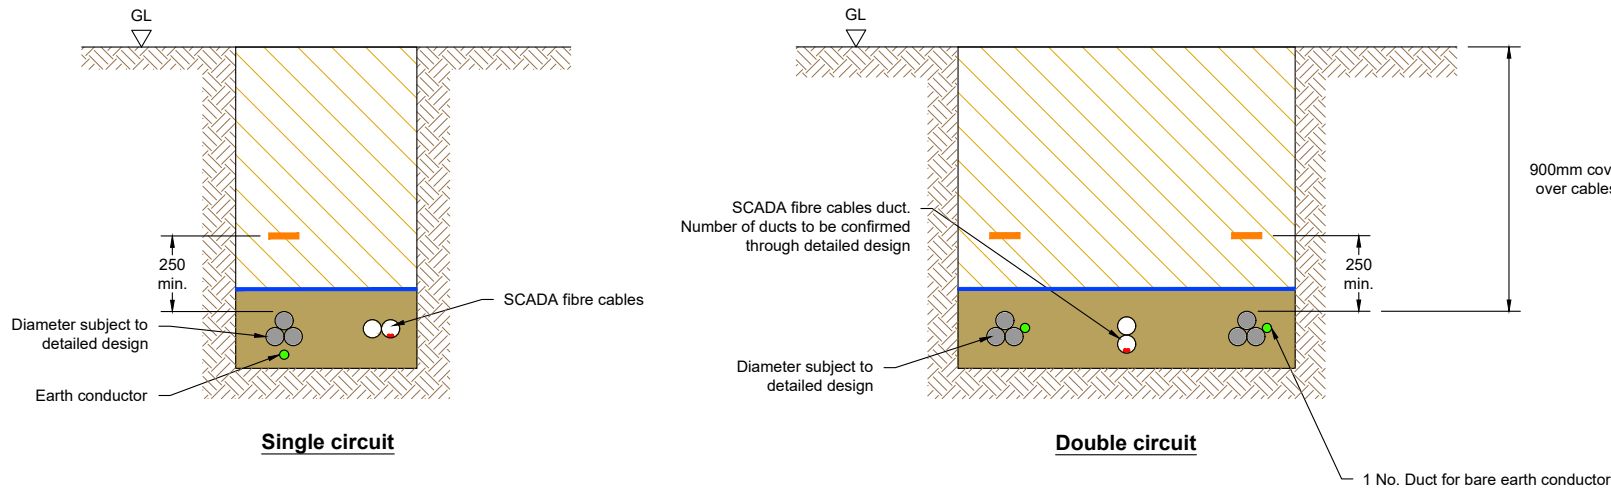

Indicative section through typical cable trench



Notes:

1. All dimensions are shown in millimetres unless stated otherwise.
2. Subject to change through detailed design.
3. Spacing between all cables to be confirmed through detailed design.
4. Indicative detail shown will be extended should more circuits be required.
5. Do not scale from this drawing.

Legend:

	Suitable fill
	Geotextile
	Bedding material
	Cable warning tape
	Approved protection tile
	Concrete surround

P02	Layout and text amendments	09/09/26	CM	RA	RA
P01	Initial Issue	08/07/26	SJB	LM	RA
Rev	Amendments	Date	By	Chk	Auth



www.slrconsulting.com

Client



Project

Dalfad Wind Farm

Figure Title

Figure 2.5
Typical Cable Trench

Scale 1:25 @ A3		SLR Project No. 413.057968.00001	
Designed N/A	Drawn SJB	Checked LM	Authorised RA
Date N/A	Date 08/07/2026	Date 08/07/2026	Date 08/07/2026
Figure Number 057968-SLR-XX-XX-F-PA-0002.5			Rev. P01