




- LEGEND**
- Site Boundary
 - Turbine Location
 - New Track Extent
 - Existing Track Extent
 - Permanent Hardstanding
 - Temporary Hardstanding
 - Substation Compound
 - SPEN Compound
 - BESS Compound
 - Construction Compound 1
 - Construction Compound 2
 - Construction Compound 3
 - Borrow Pit Search Area

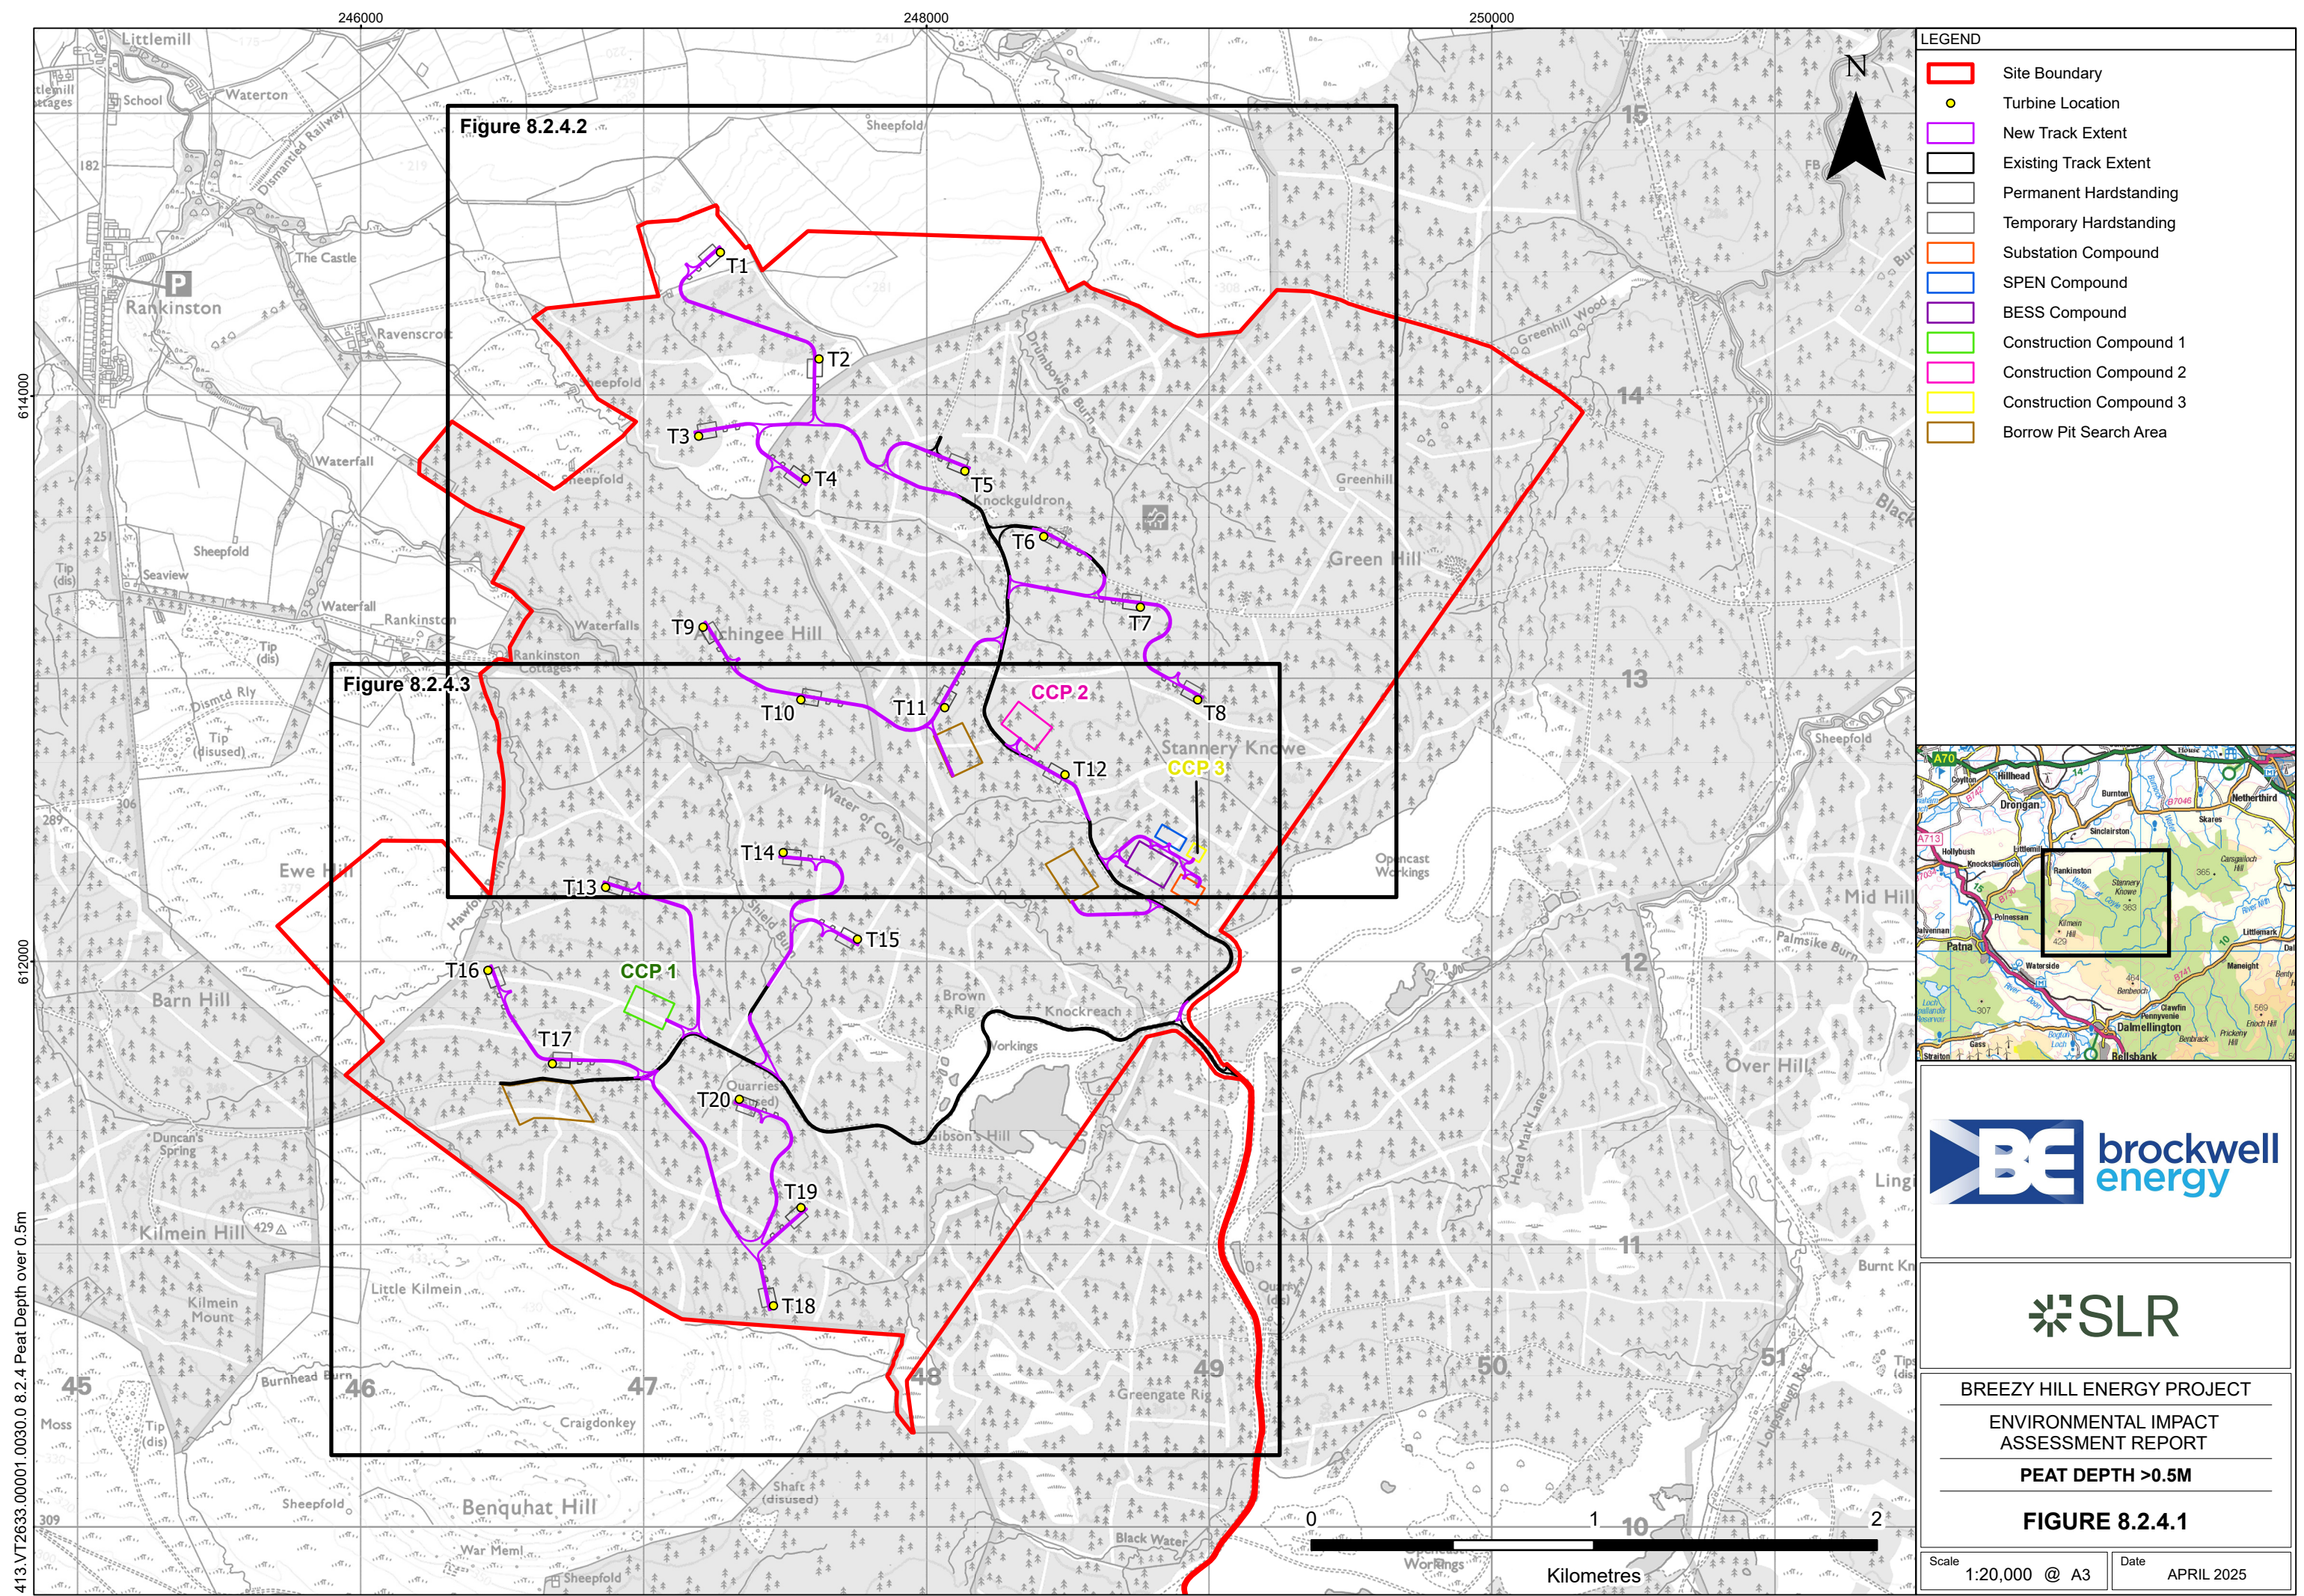


BREEZY HILL ENERGY PROJECT

ENVIRONMENTAL IMPACT
ASSESSMENT REPORT

PEAT DEPTH >0.5M

FIGURE 8.2.4.1

Scale 1:20,000 @ A3 Date APRIL 2025

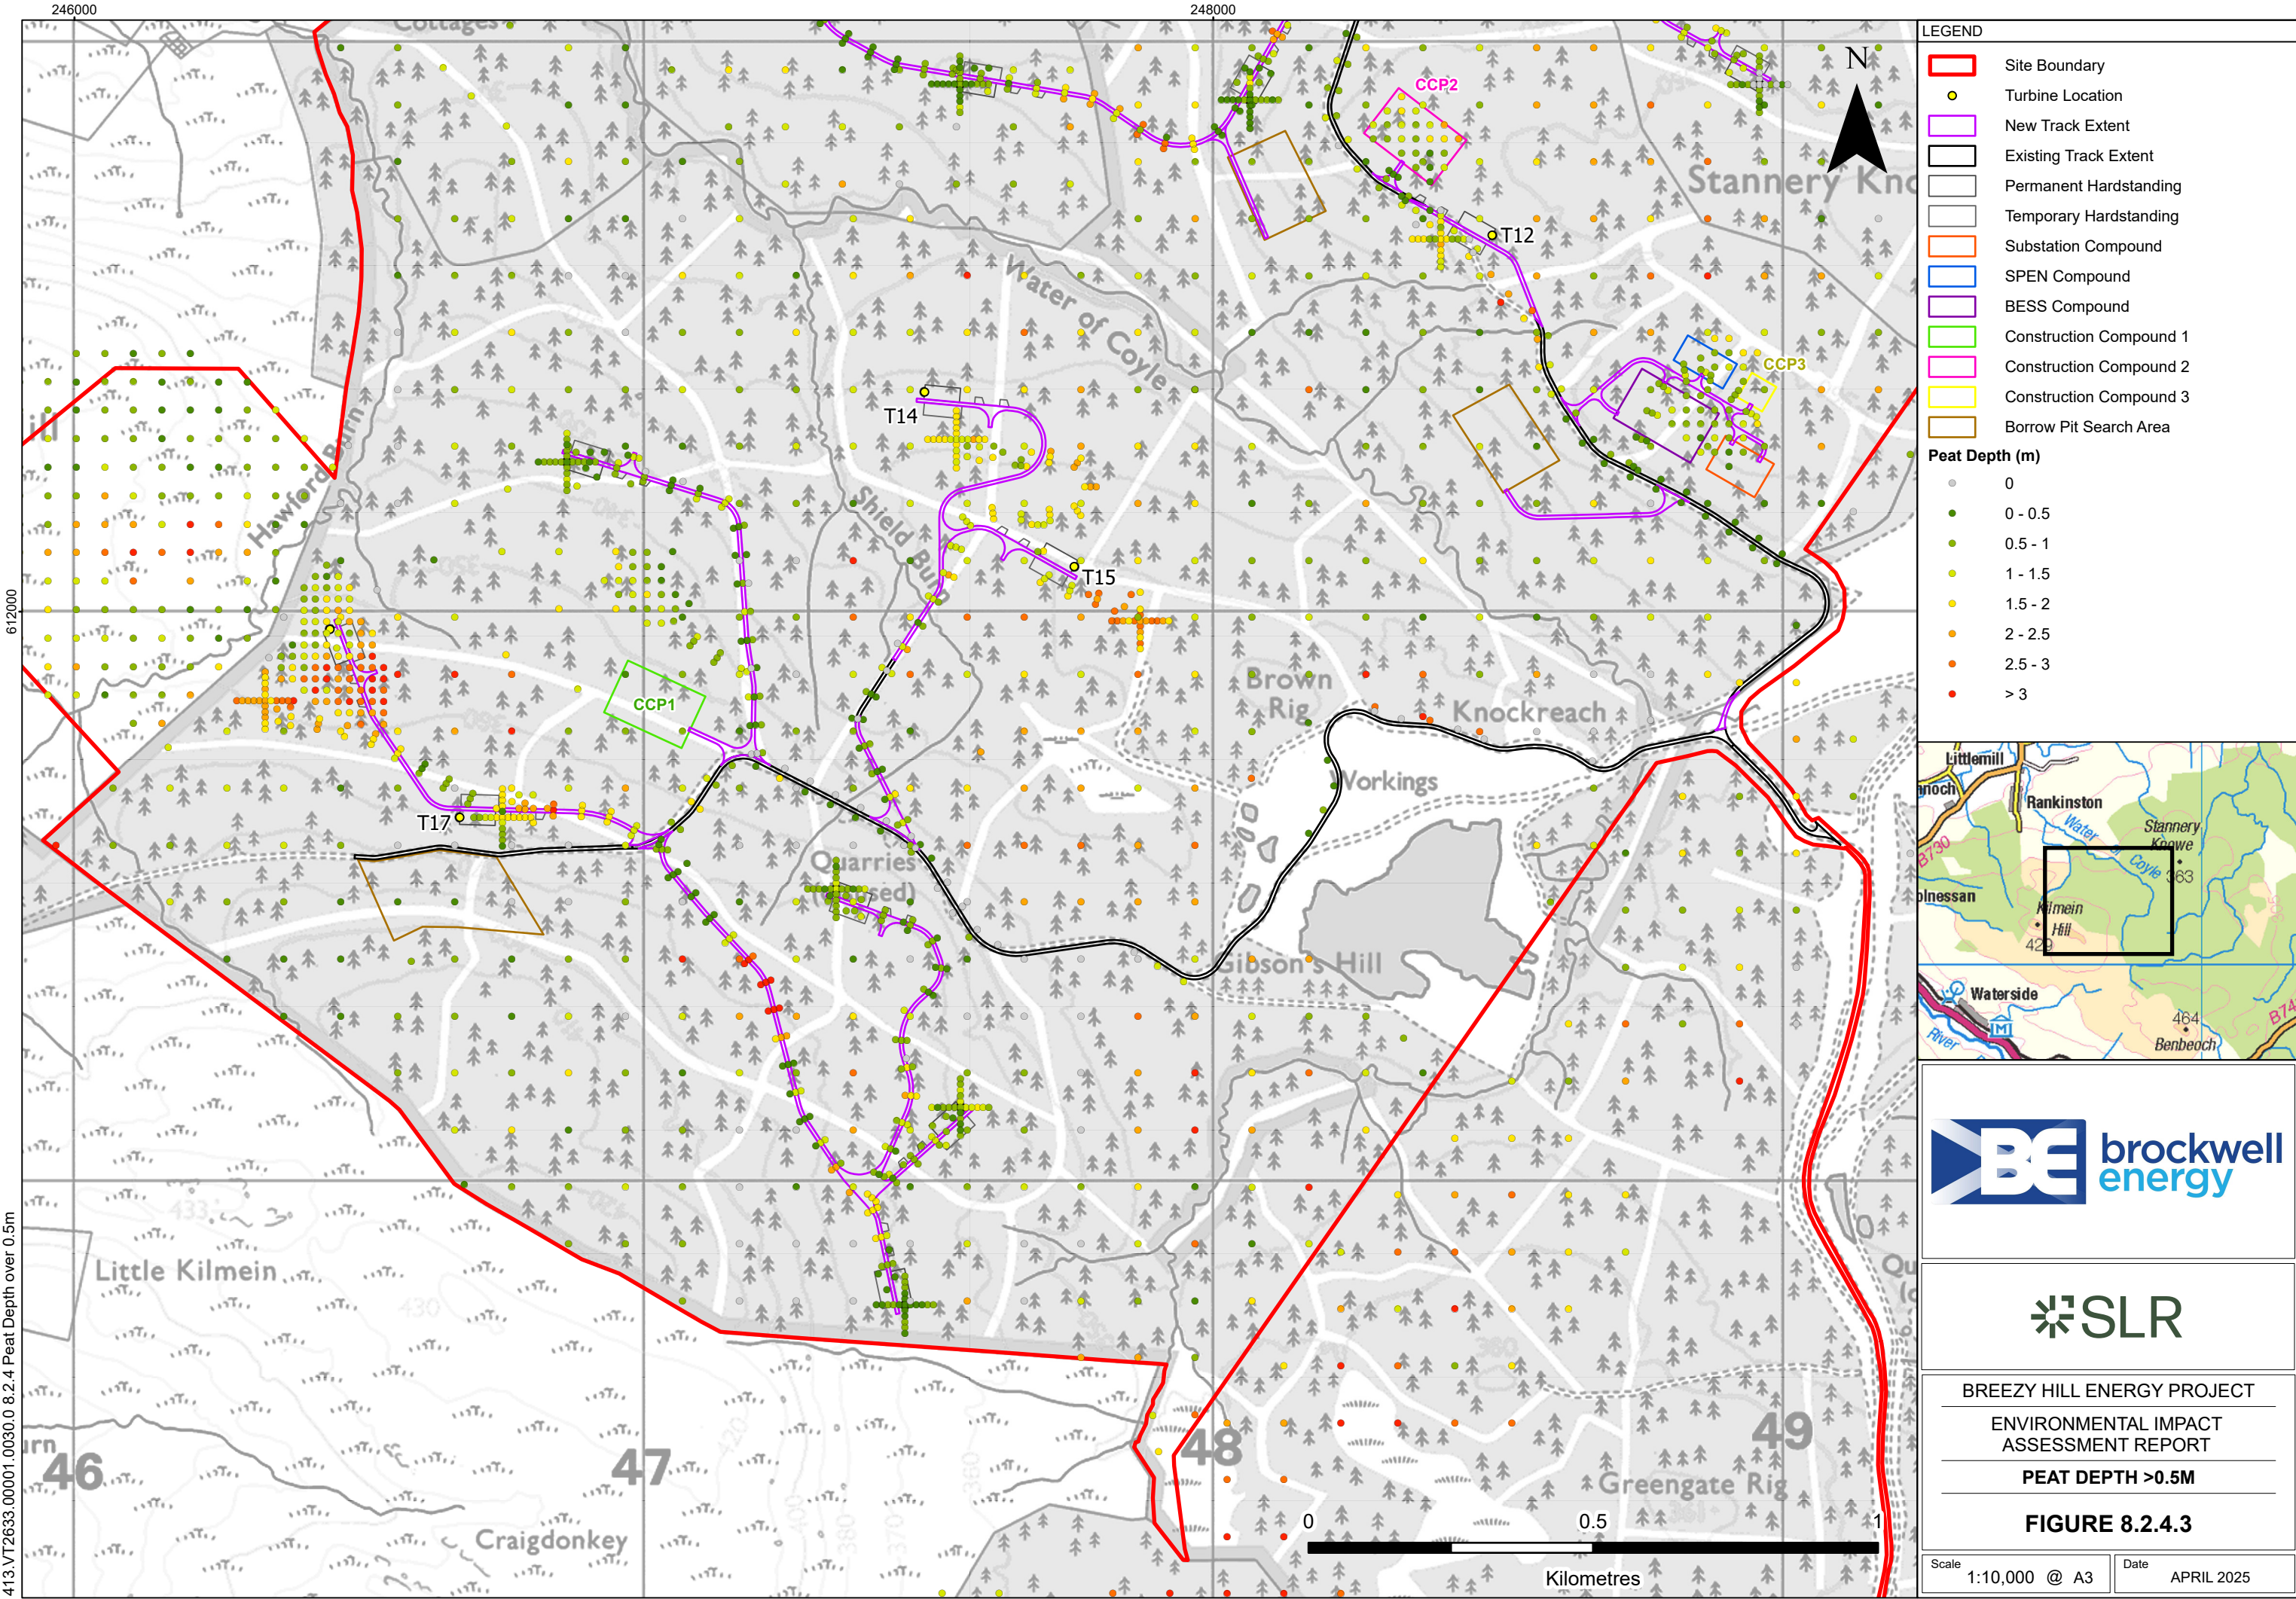

LEGEND

- Site Boundary
- Turbine Location
- New Track Extent
- Existing Track Extent
- Permanent Hardstanding
- Temporary Hardstanding
- Substation Compound
- SPEN Compound
- BESS Compound
- Construction Compound 1
- Construction Compound 2
- Construction Compound 3
- Borrow Pit Search Area

Peat Depth (m)

- 0
- 0 - 0.5
- 0.5 - 1
- 1 - 1.5
- 1.5 - 2
- 2 - 2.5
- 2.5 - 3
- > 3





BREEZY HILL ENERGY PROJECT

ENVIRONMENTAL IMPACT
ASSESSMENT REPORT

PEAT DEPTH >0.5M

FIGURE 8.2.4.3

Scale 1:10,000 @ A3

Date APRIL 2025