

LEGEND

- Site Boundary
- Private Water Supply (PWS) 2 km Study Area (Main Site Area 2 km Buffer)
- Turbine Location
- New Track Extent
- Existing Track Extent
- Permanent Hardstanding
- Temporary Hardstanding
- Substation Compound
- SPEN Compound
- BESS Compound
- Construction Compound 1
- Construction Compound 2
- Construction Compound 3
- Borrow Pit Search Area

Private Water Supply (PWS) Type

- Mains
- Spring
- Stream Abstraction
- Unconfirmed

BREEZY HILL ENERGY PROJECT


ENVIRONMENTAL IMPACT ASSESSMENT REPORT

PRIVATE WATER SUPPLY (PWS) RISK ASSESSMENT


FIGURE 8.9a

Scale 1:40,000 @ A3

Date APRIL 2025

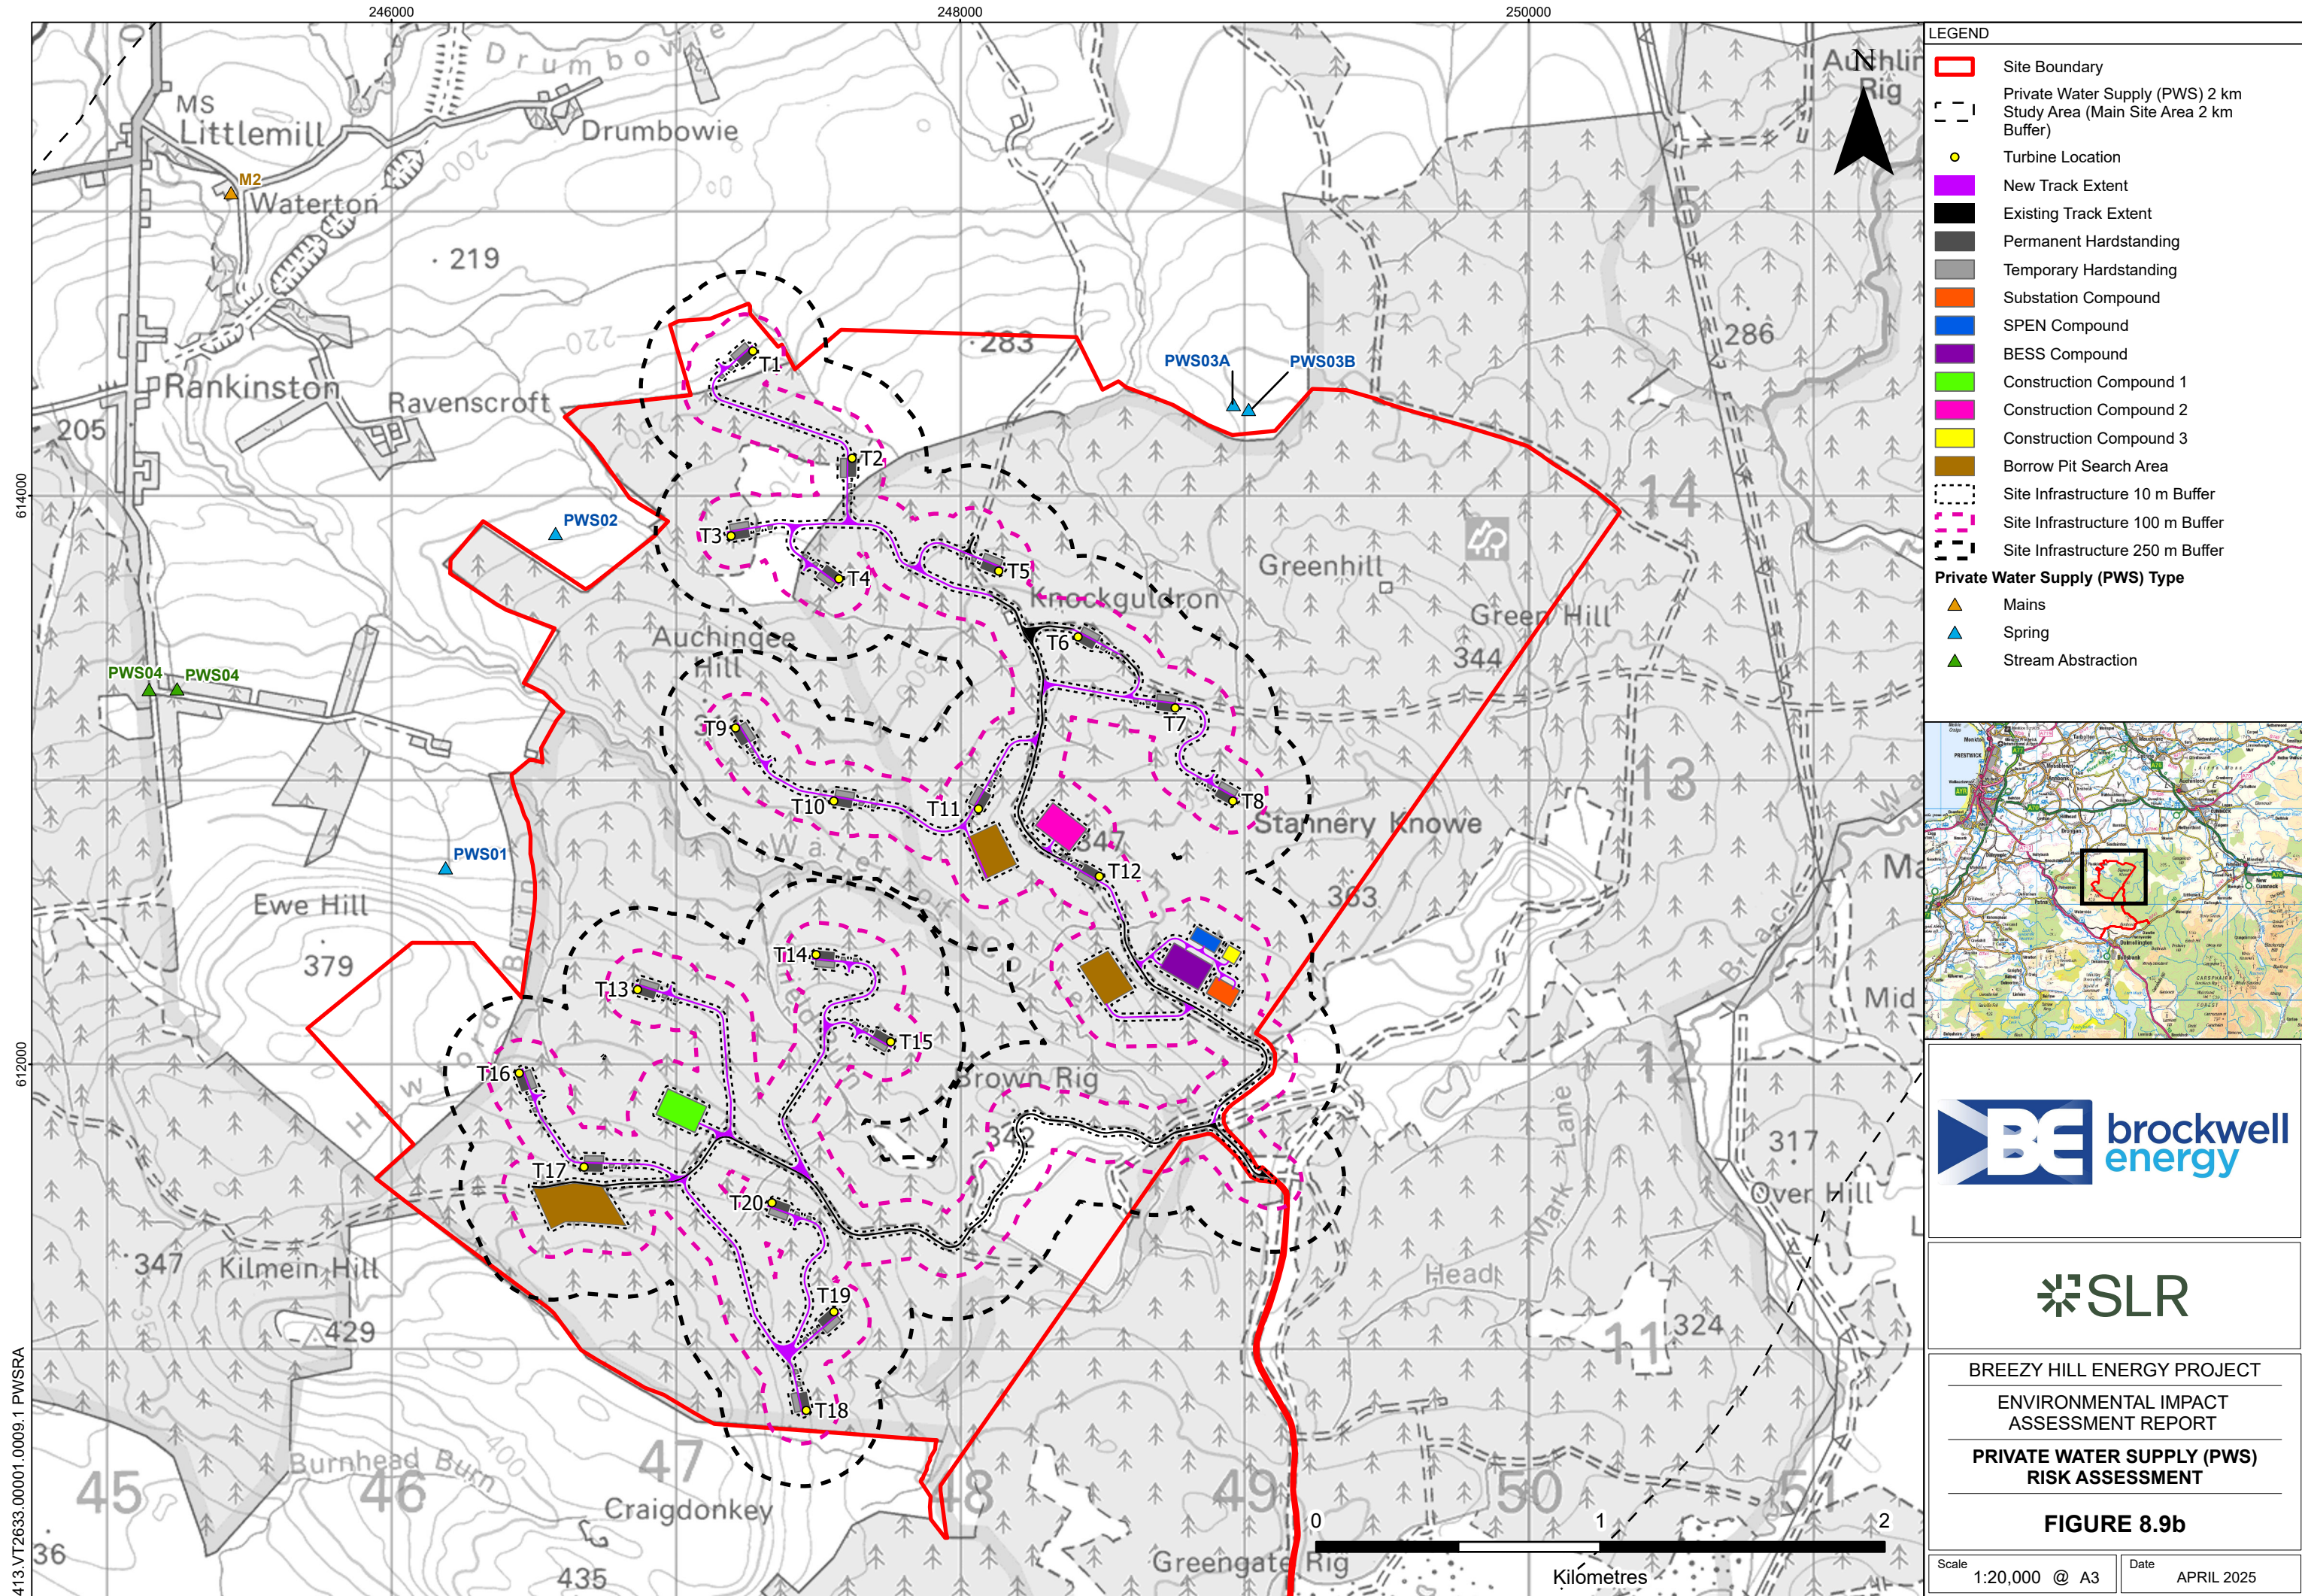

- LEGEND**
- Site Boundary
 - Private Water Supply (PWS) 2 km Study Area (Main Site Area 2 km Buffer)
 - Turbine Location
 - New Track Extent
 - Existing Track Extent
 - Permanent Hardstanding
 - Temporary Hardstanding
 - Substation Compound
 - SPEN Compound
 - BESS Compound
 - Construction Compound 1
 - Construction Compound 2
 - Construction Compound 3
 - Borrow Pit Search Area
 - Site Infrastructure 10 m Buffer
 - Site Infrastructure 100 m Buffer
 - Site Infrastructure 250 m Buffer
- Private Water Supply (PWS) Type**
- Mains
 - Spring
 - Stream Abstraction

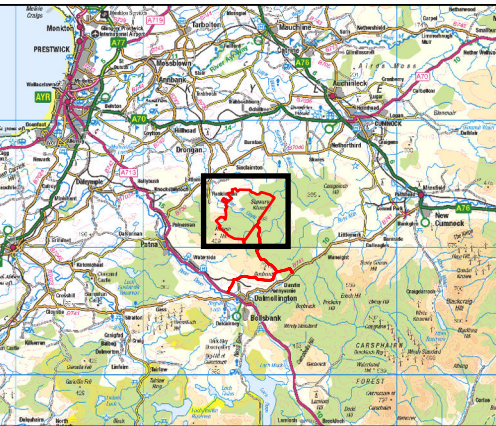

BREEZY HILL ENERGY PROJECT

ENVIRONMENTAL IMPACT
ASSESSMENT REPORT

PRIVATE WATER SUPPLY (PWS)
RISK ASSESSMENT

FIGURE 8.9b

Scale 1:20,000 @ A3

Date APRIL 2025