



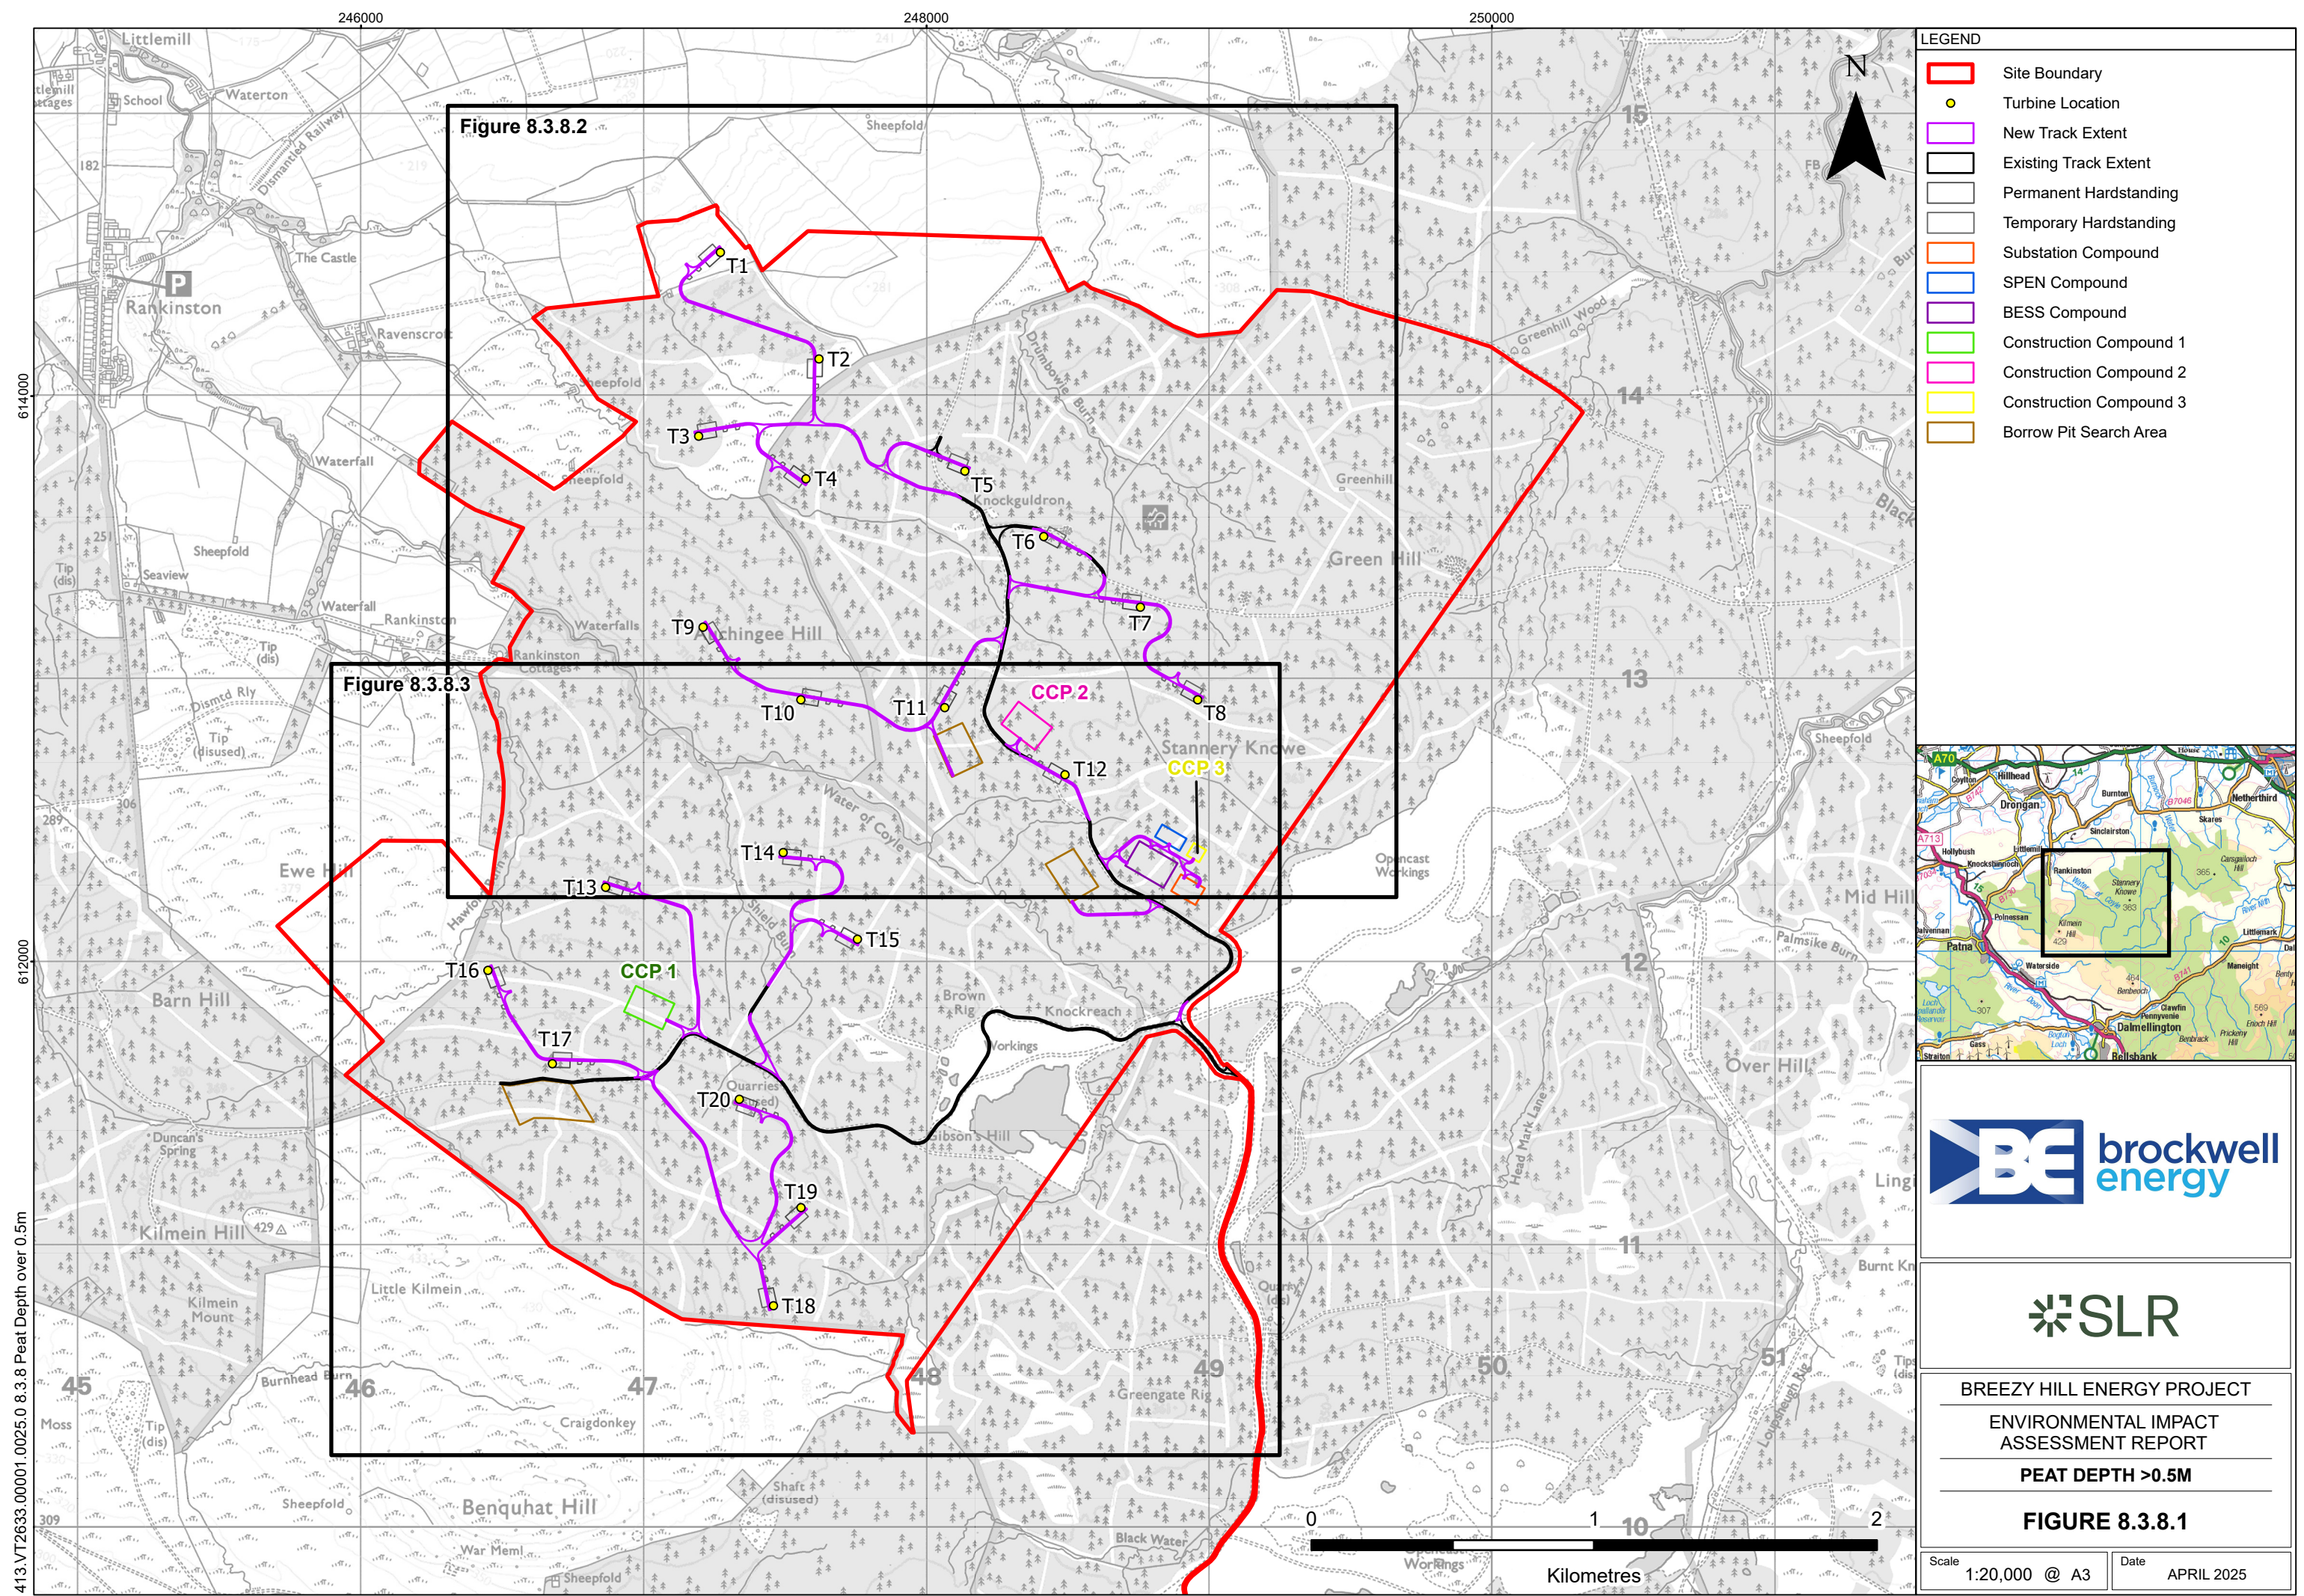

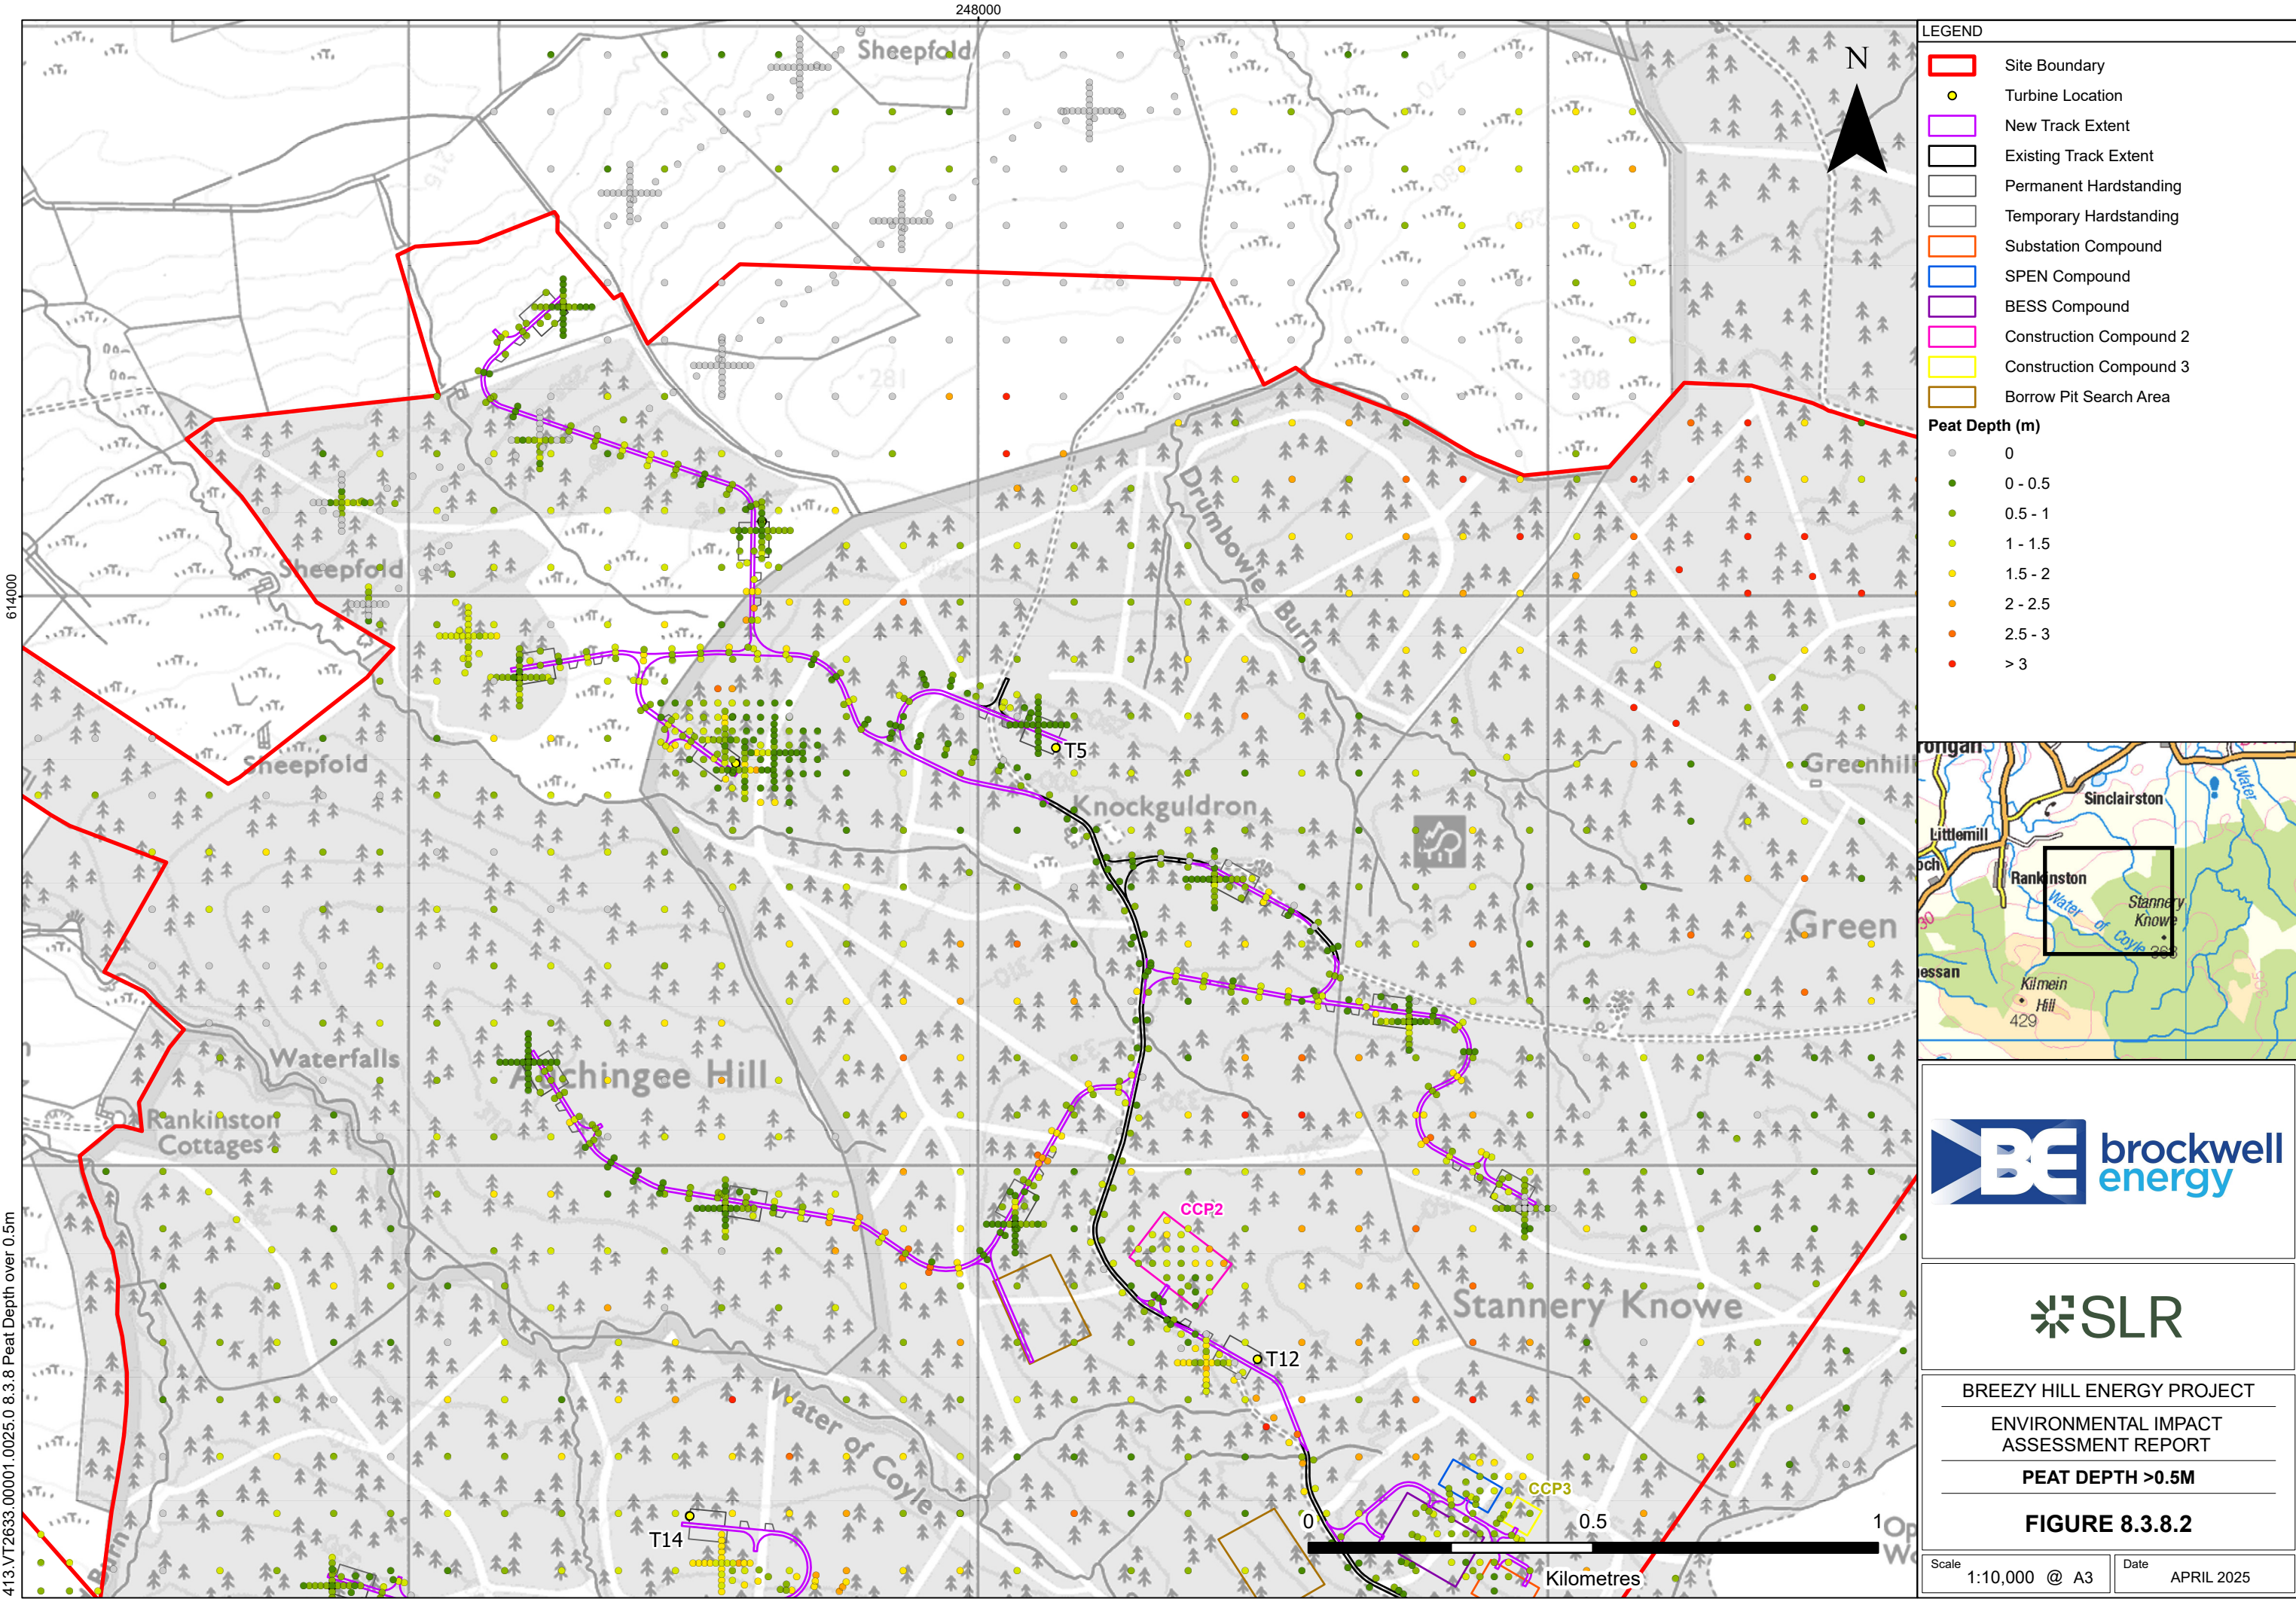


LEGEND

- Site Boundary
- Turbine Location
- New Track Extent
- Existing Track Extent
- Permanent Hardstanding
- Temporary Hardstanding
- Substation Compound
- SPEN Compound
- BESS Compound
- Construction Compound 2
- Construction Compound 3
- Borrow Pit Search Area

Peat Depth (m)

- 0
- 0 - 0.5
- 0.5 - 1
- 1 - 1.5
- 1.5 - 2
- 2 - 2.5
- 2.5 - 3
- > 3

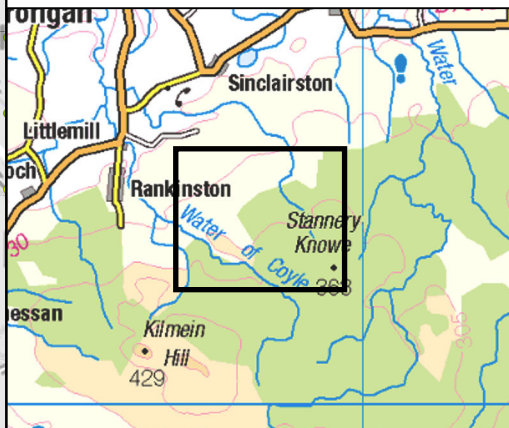


BREEZY HILL ENERGY PROJECT

ENVIRONMENTAL IMPACT ASSESSMENT REPORT

PEAT DEPTH >0.5M

FIGURE 8.3.8.2

Scale 1:10,000 @ A3 Date APRIL 2025

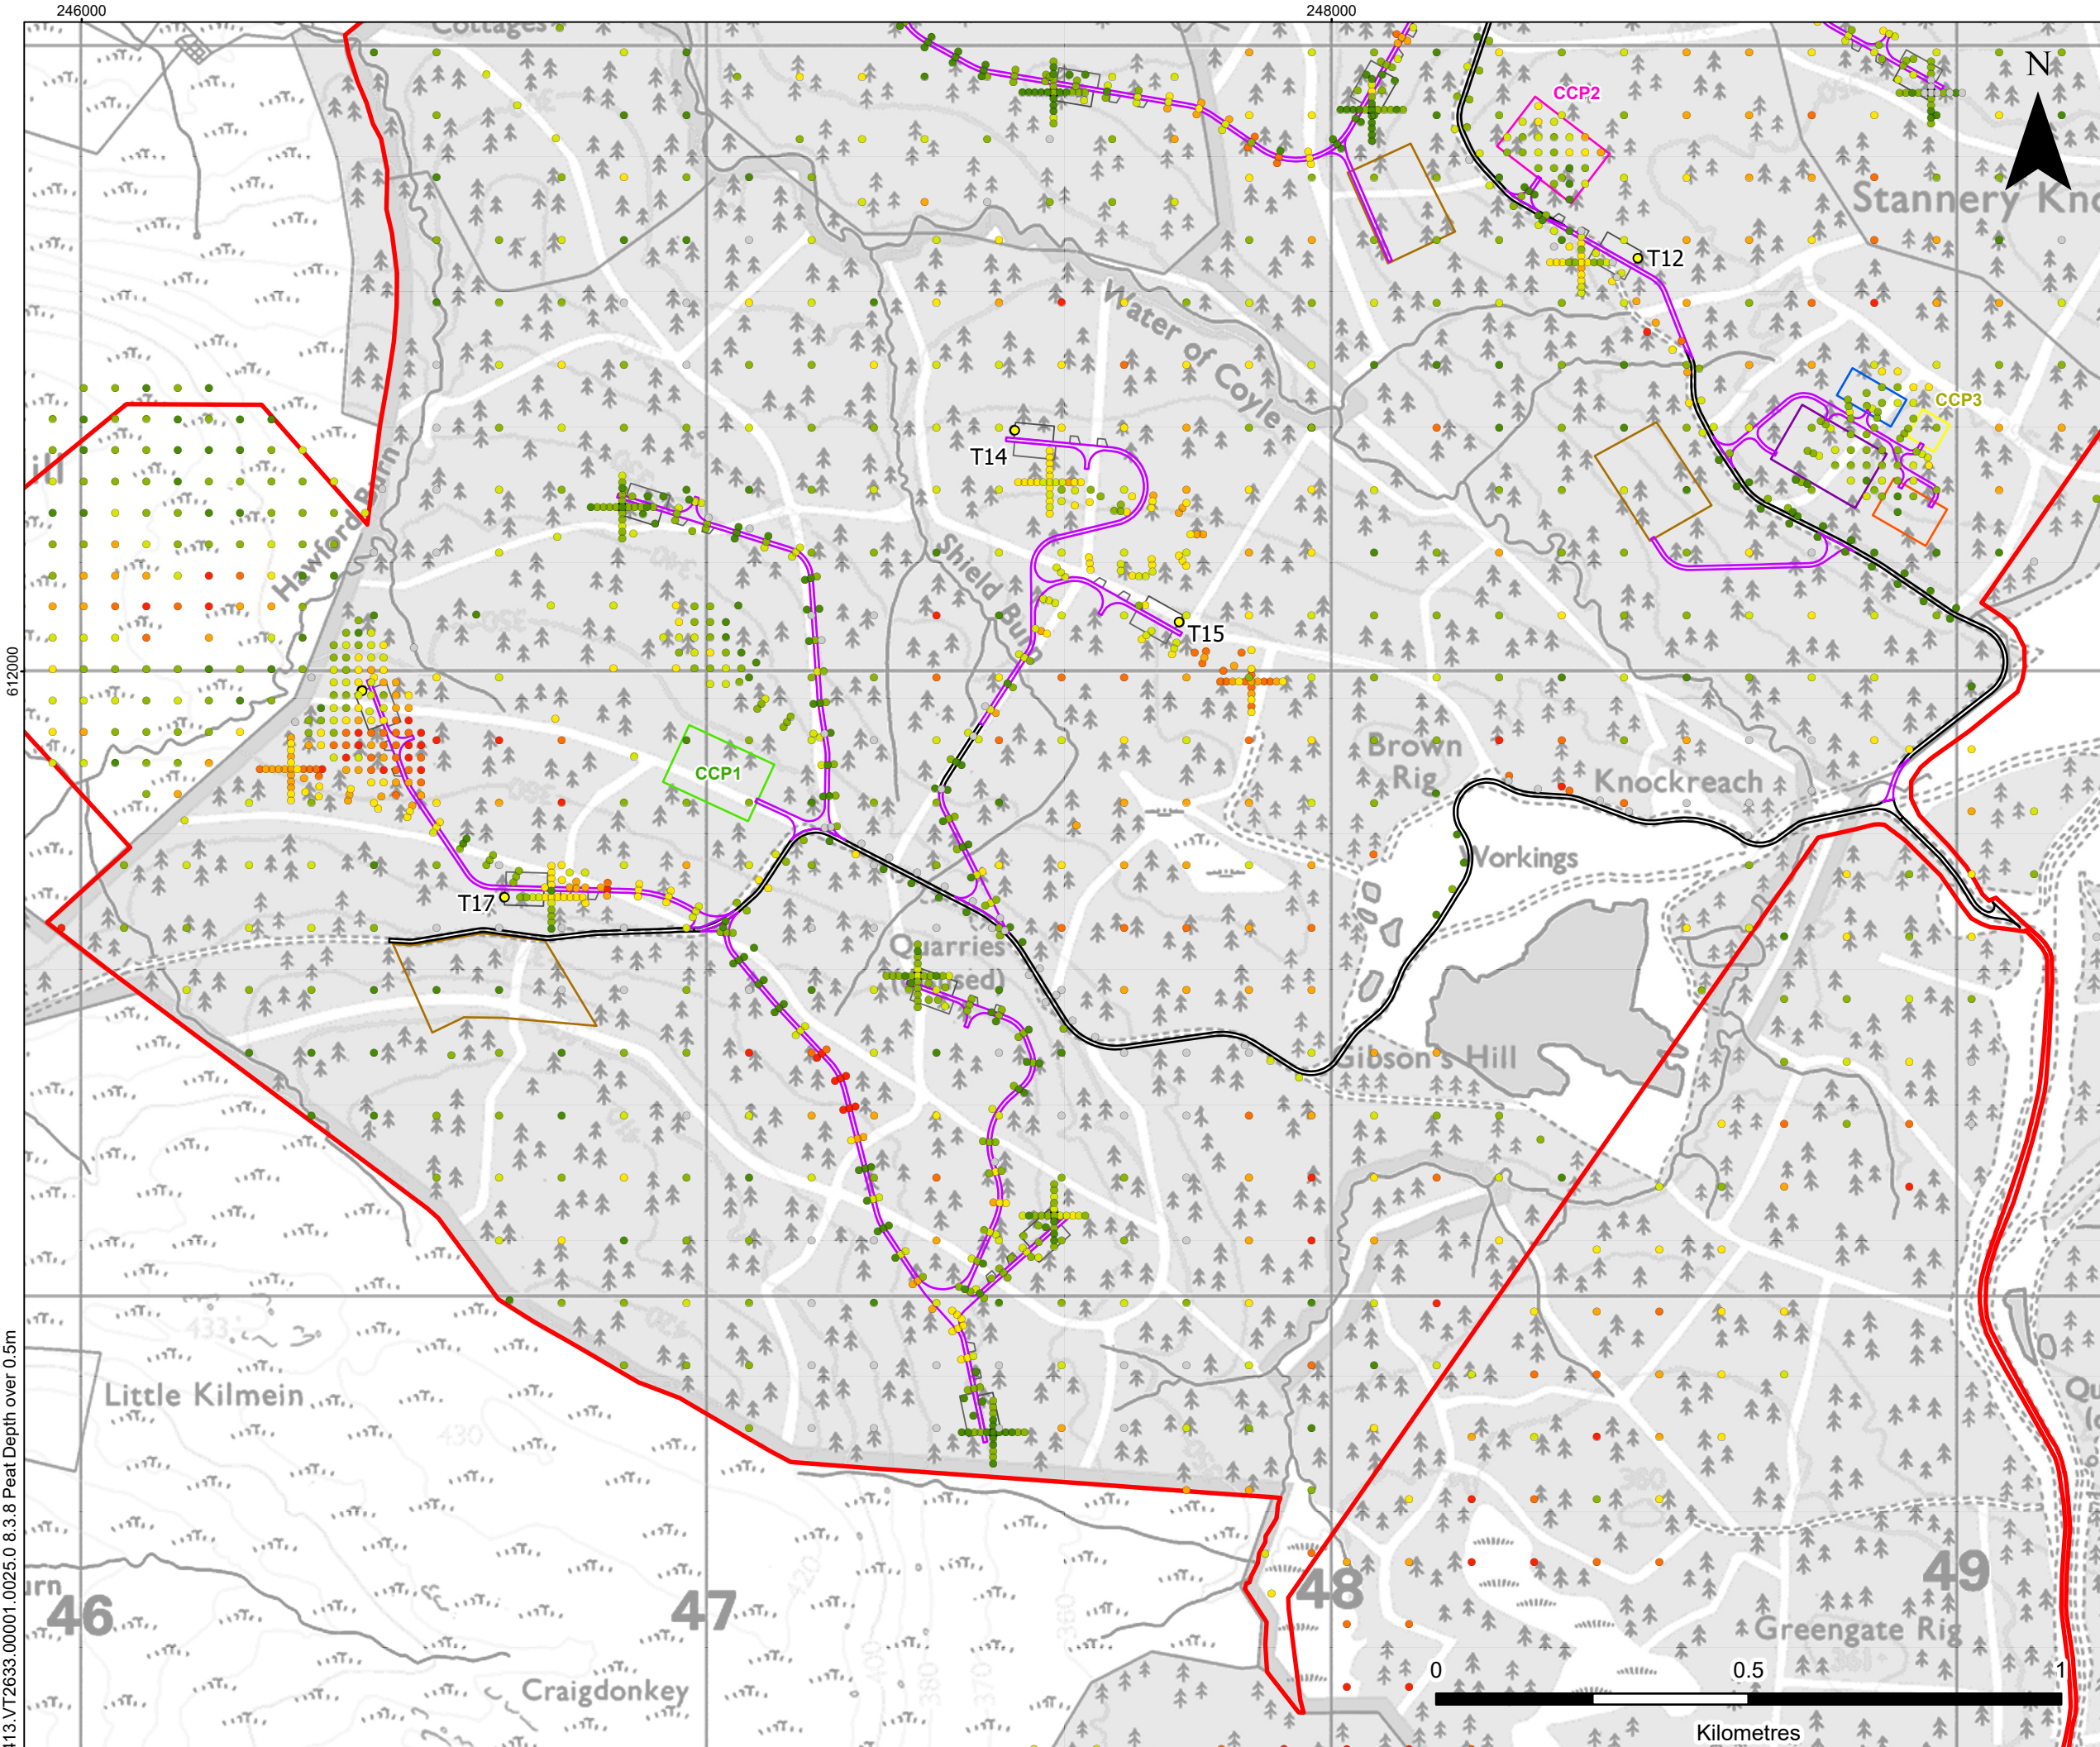

LEGEND

- Site Boundary
- Turbine Location
- New Track Extent
- Existing Track Extent
- Permanent Hardstanding
- Temporary Hardstanding
- Substation Compound
- SPEN Compound
- BESS Compound
- Construction Compound 1
- Construction Compound 2
- Construction Compound 3
- Borrow Pit Search Area

Peat Depth (m)

- 0
- 0 - 0.5
- 0.5 - 1
- 1 - 1.5
- 1.5 - 2
- 2 - 2.5
- 2.5 - 3
- > 3





BREEZY HILL ENERGY PROJECT

ENVIRONMENTAL IMPACT
ASSESSMENT REPORT

PEAT DEPTH >0.5M

FIGURE 8.3.8.3

Scale 1:10,000 @ A3

Date APRIL 2025