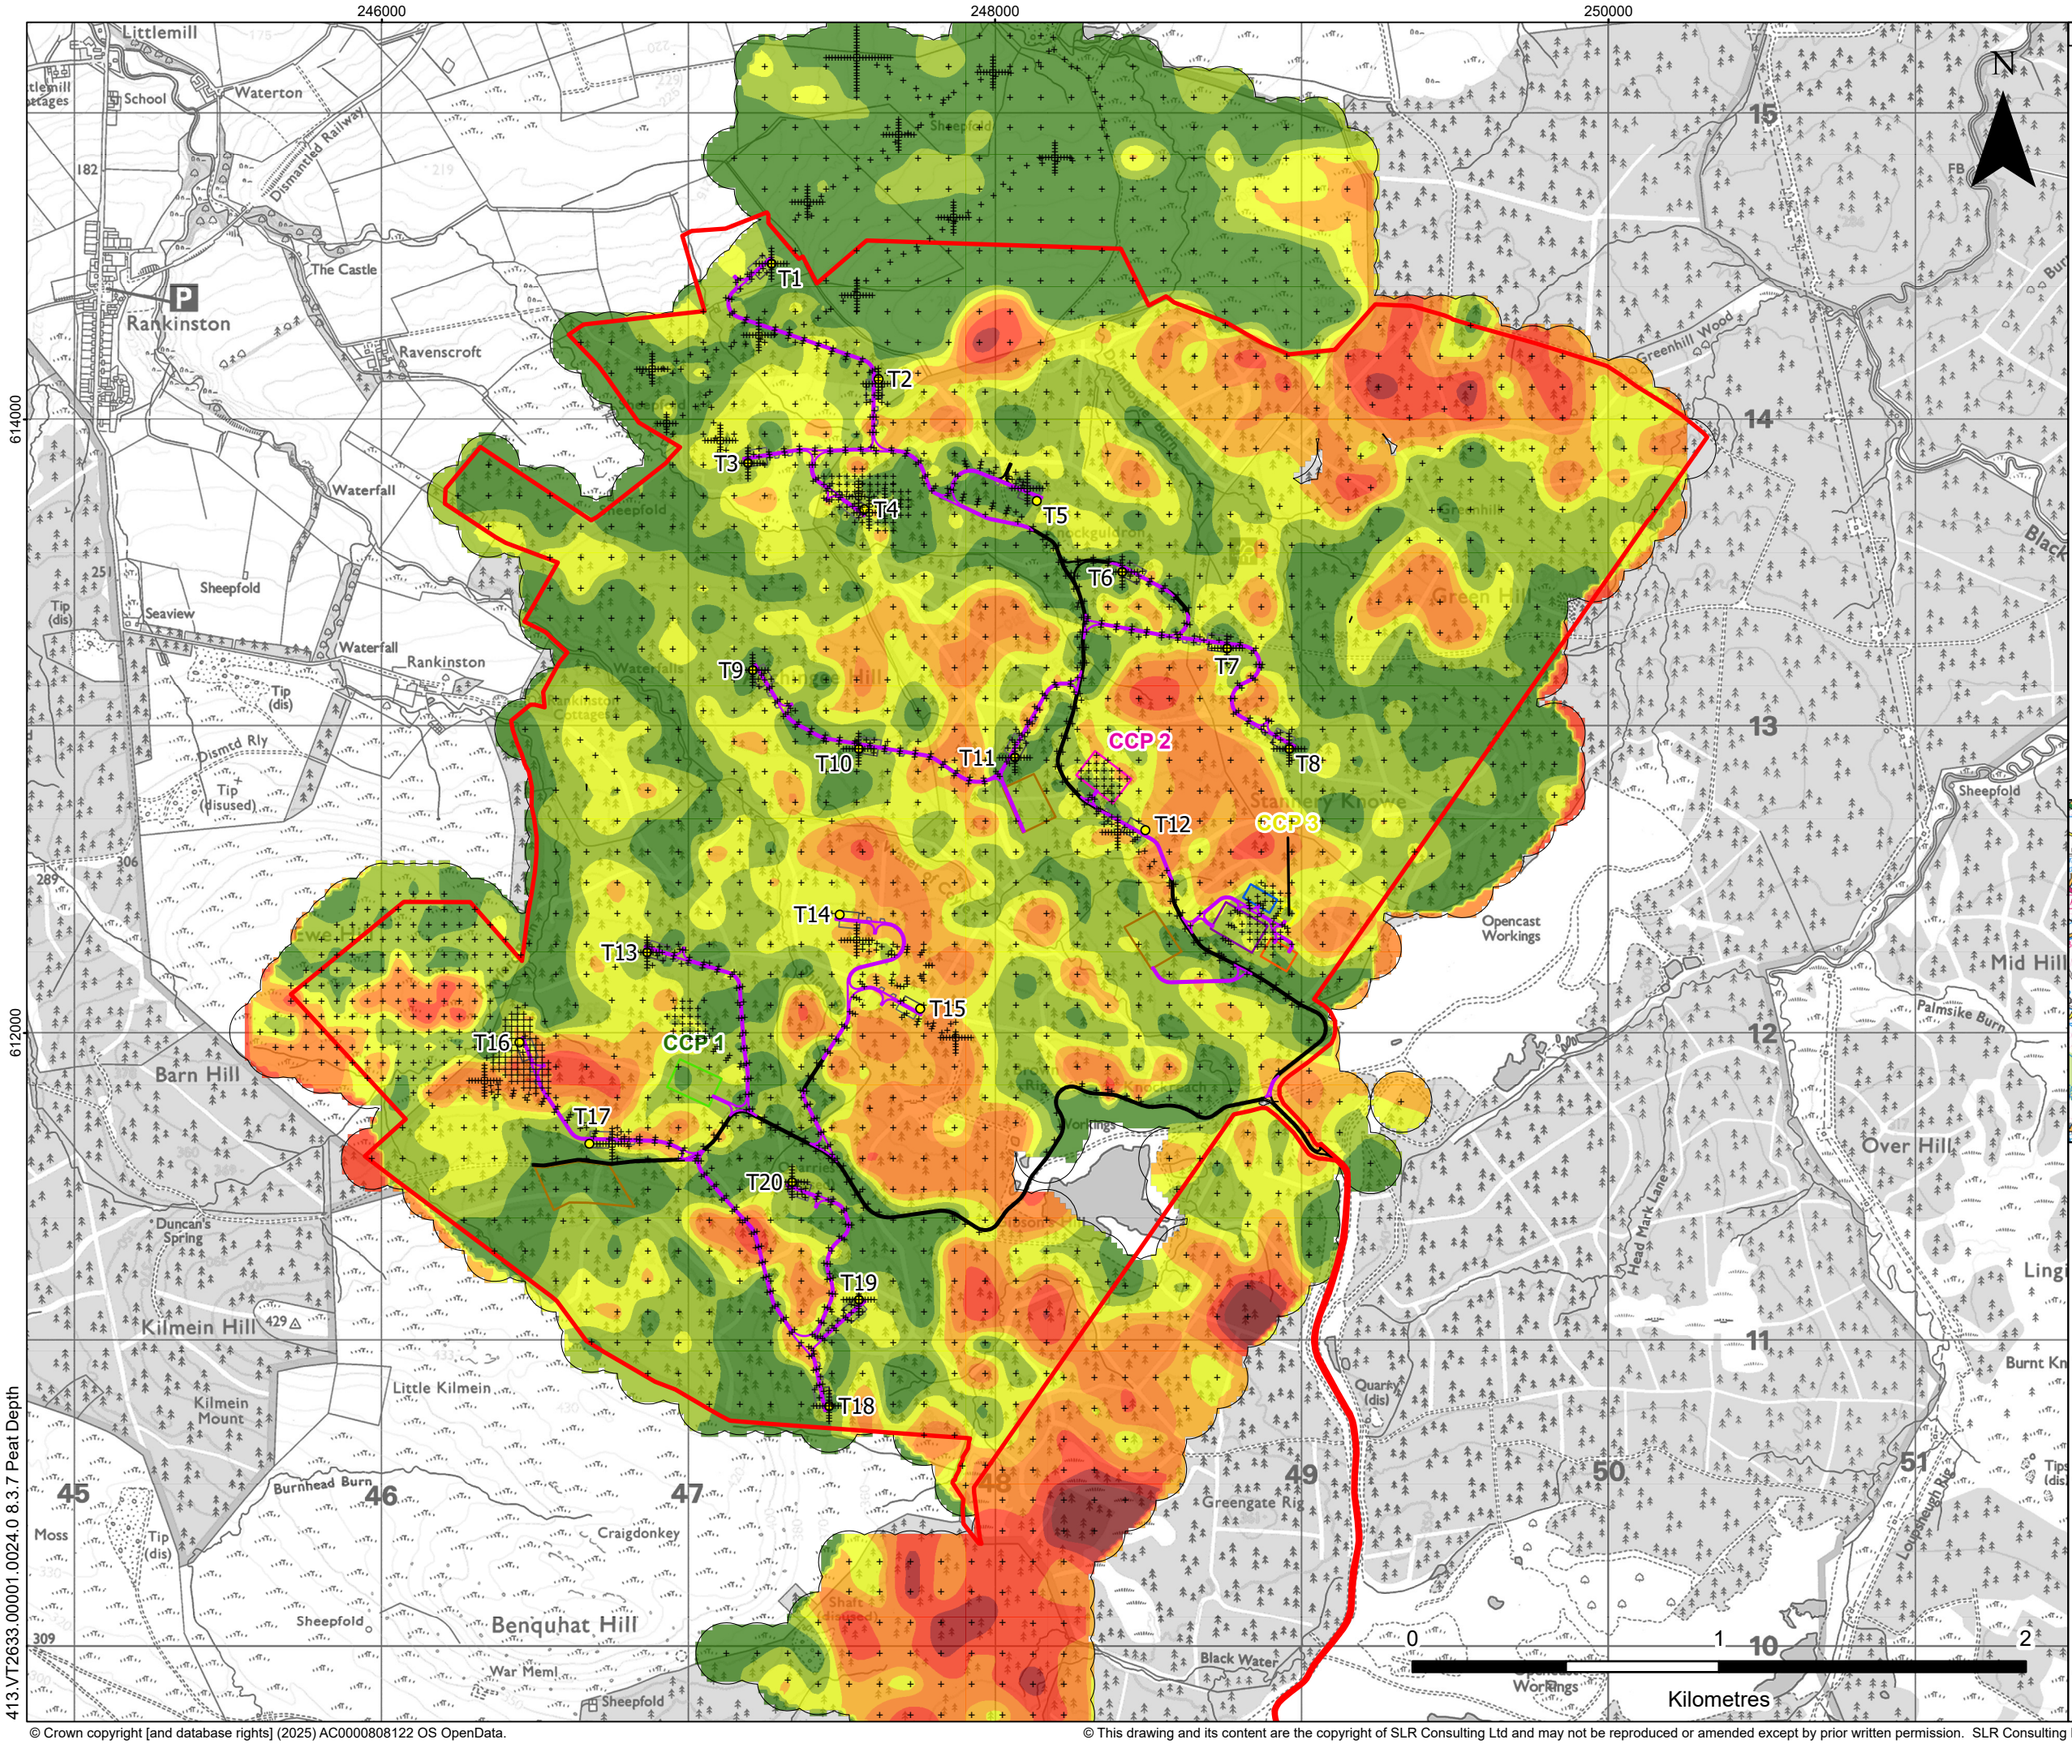

LEGEND

- Site Boundary
- Turbine Location
- New Track Extent
- Existing Track Extent
- Permanent Hardstanding
- Temporary Hardstanding
- Substation Compound
- SPEN Compound
- BESS Compound
- Construction Compound 1
- Construction Compound 2
- Construction Compound 3
- Borrow Pit Search Area
- Peat Probe Location

Peat Depth (m)

- 0 - 0.5
- 0.5 - 1
- 1 - 1.5
- 1.5- 2
- 2 - 3
- 3 - 4
- 4 - 5
- >5

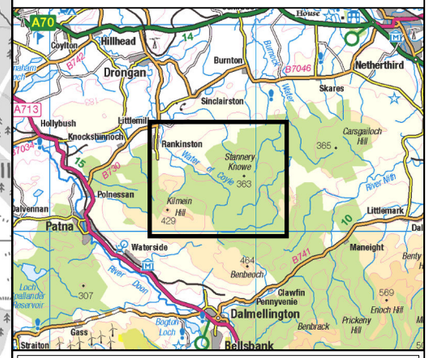

brockwell energy

SLR

BREEZY HILL ENERGY PROJECT

ENVIRONMENTAL IMPACT ASSESSMENT REPORT

PEAT DEPTH

FIGURE 8.3.7

Scale	Date
1:20,000 @ A3	APRIL 2025

413.VT2633.00001.0024.0 8.3.7 Peat Depth

© Crown copyright [and database rights] (2025) AC0000808122 OS OpenData.

© This drawing and its content are the copyright of SLR Consulting Ltd and may not be reproduced or amended except by prior written permission. SLR Consulting Ltd accepts no liability for any amendments made by other persons.