




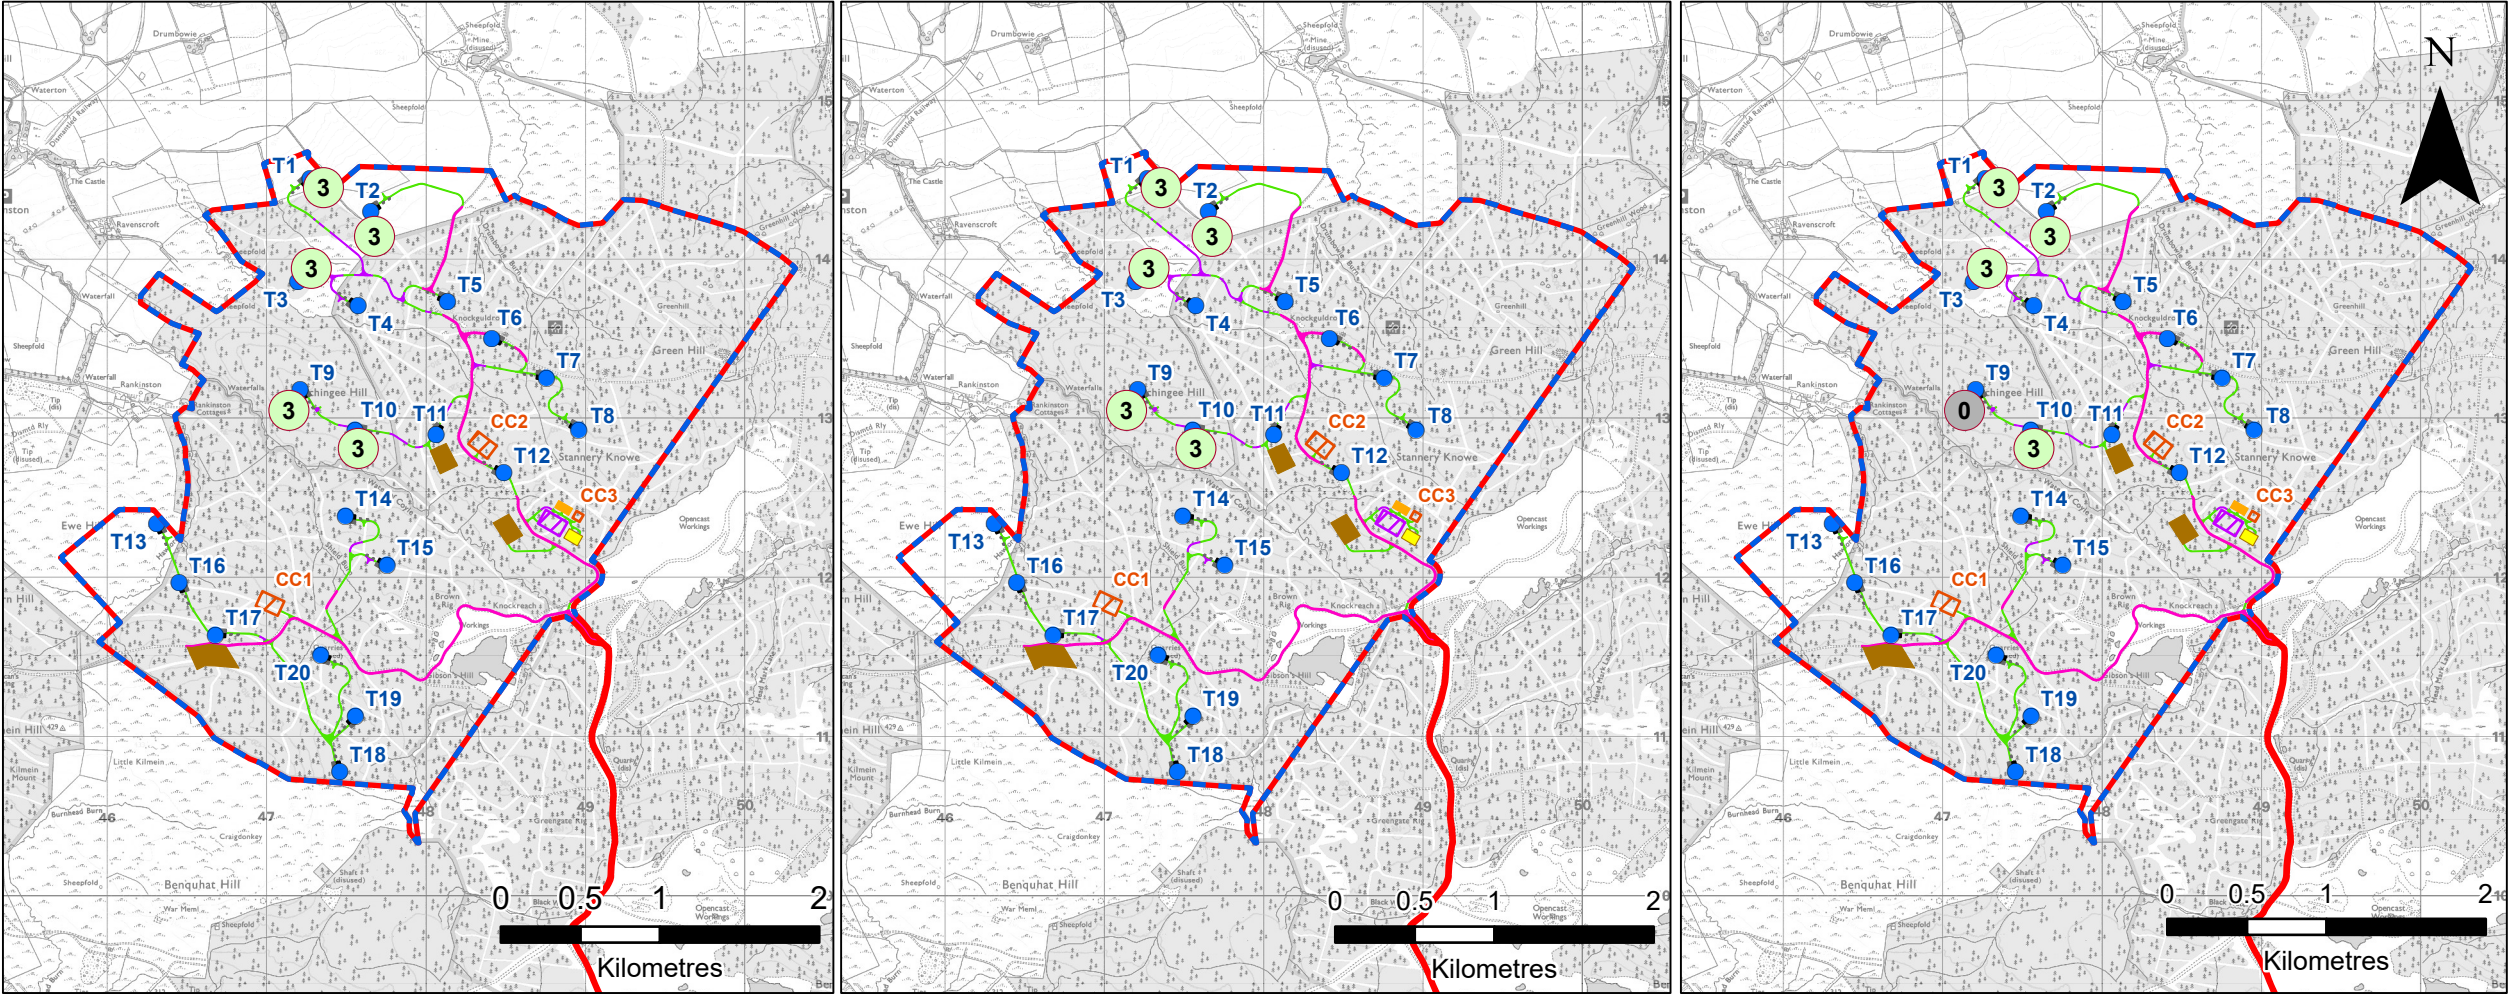

April 2025 Scale - 1:47,500 @ A3 May 2025 Scale - 1:47,500 @ A3 June 2025 Scale - 1:47,500 @ A3

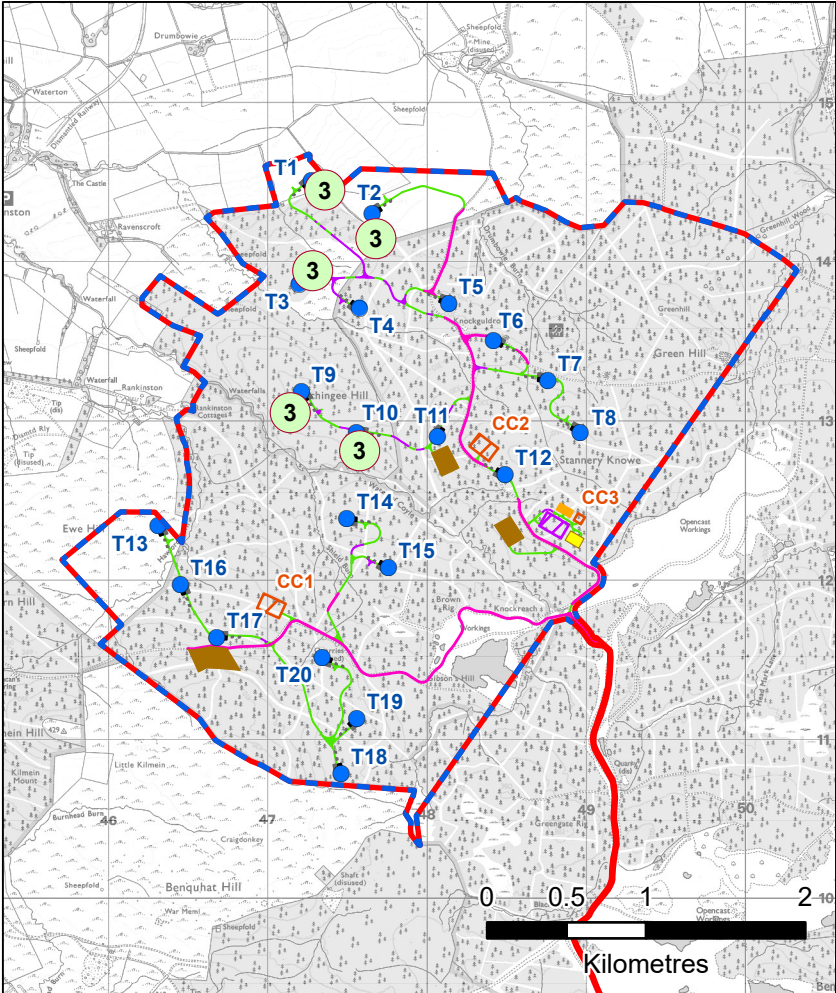


August 2025 Scale - 1:47,500 @ A3

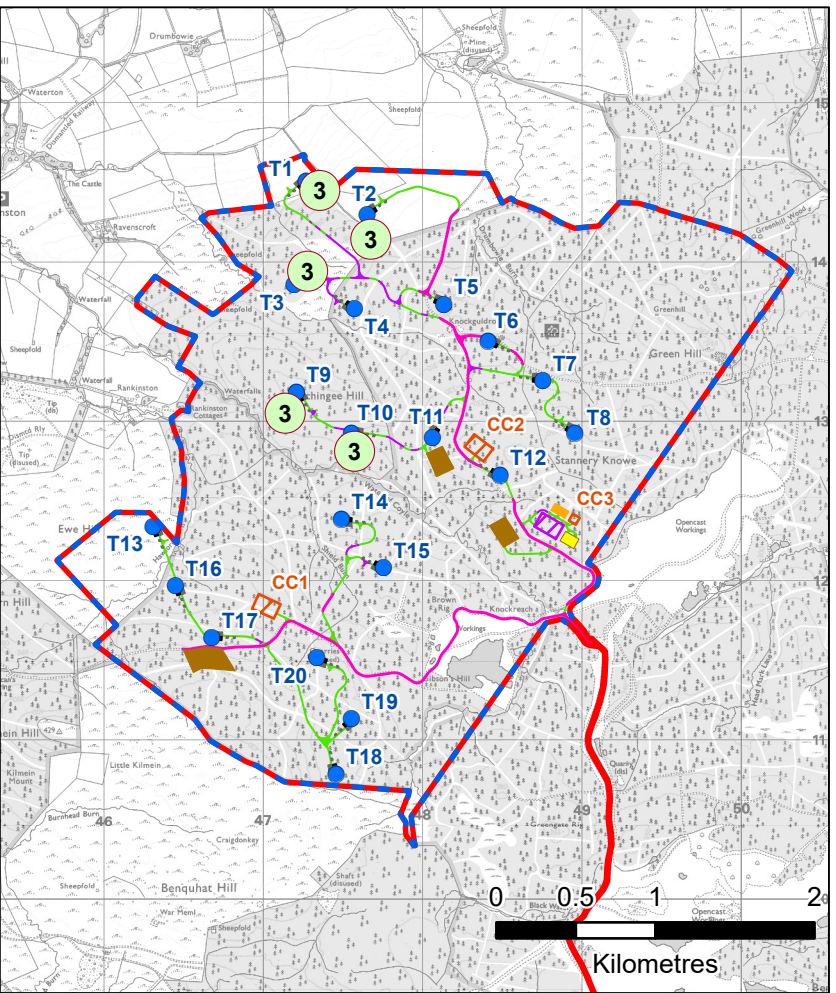

September 2025 Scale - 1:47,500 @ A3

LEGEND

- Site Boundary
- Turbine Location
- Substation Compound
- Scottish Power Energy Network (SPEN) Compound
- Battery Energy Storage System (BESS) Compound
- Construction Compound
- Borrow Pit Search Area
- Temporary Hardstanding
- Permanent Hardstanding
- Existing Track
- New Floating Track
- New Access Track
- Bat Potential Roost Feature (PRF) Survey Area
- Overall Median Risk Assessment Category
 - Low
 - No Data

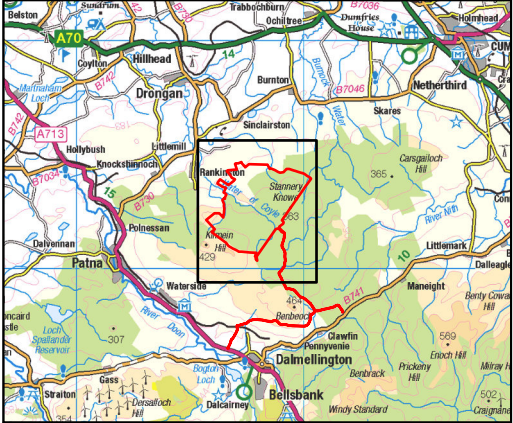

BE brockwell energy

SLR

BREEZY HILL ENERGY PROJECT

ADDITIONAL INFORMATION - REVISED EIA REPORT

BAT SITE ACTIVITY 2025 - COMMON PIPISTRELLE

FIGURE 6.13

Date **NOVEMBER 2025**