




May 2021 Scale - 1:35,000 @ A3

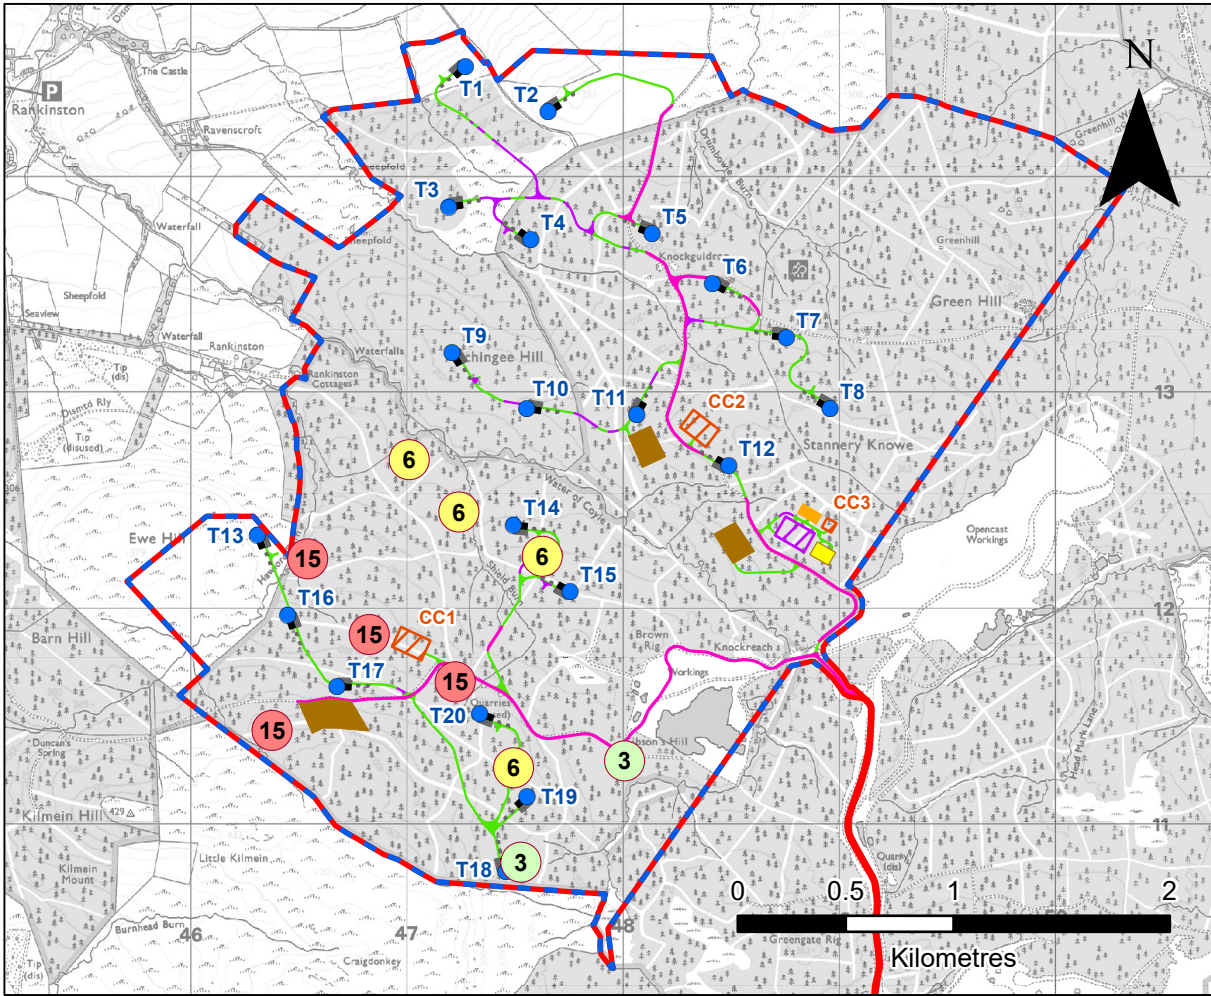


July 2021 Scale - 1:35,000 @ A3

LEGEND

- Site Boundary
- Turbine Location
- Substation Compound
- Scottish Power Energy Network (SPEN) Compound
- Battery Energy Storage System (BESS) Compound
- Construction Compound
- Borrow Pit Search Area
- Temporary Hardstanding
- Permanent Hardstanding
- New Access Track
- New Floating Track
- Existing Track
- Bat Potential Roost Feature (PRF) Survey Area
- Overall Median Risk Assessment Category**
 - High
 - Medium
 - Low

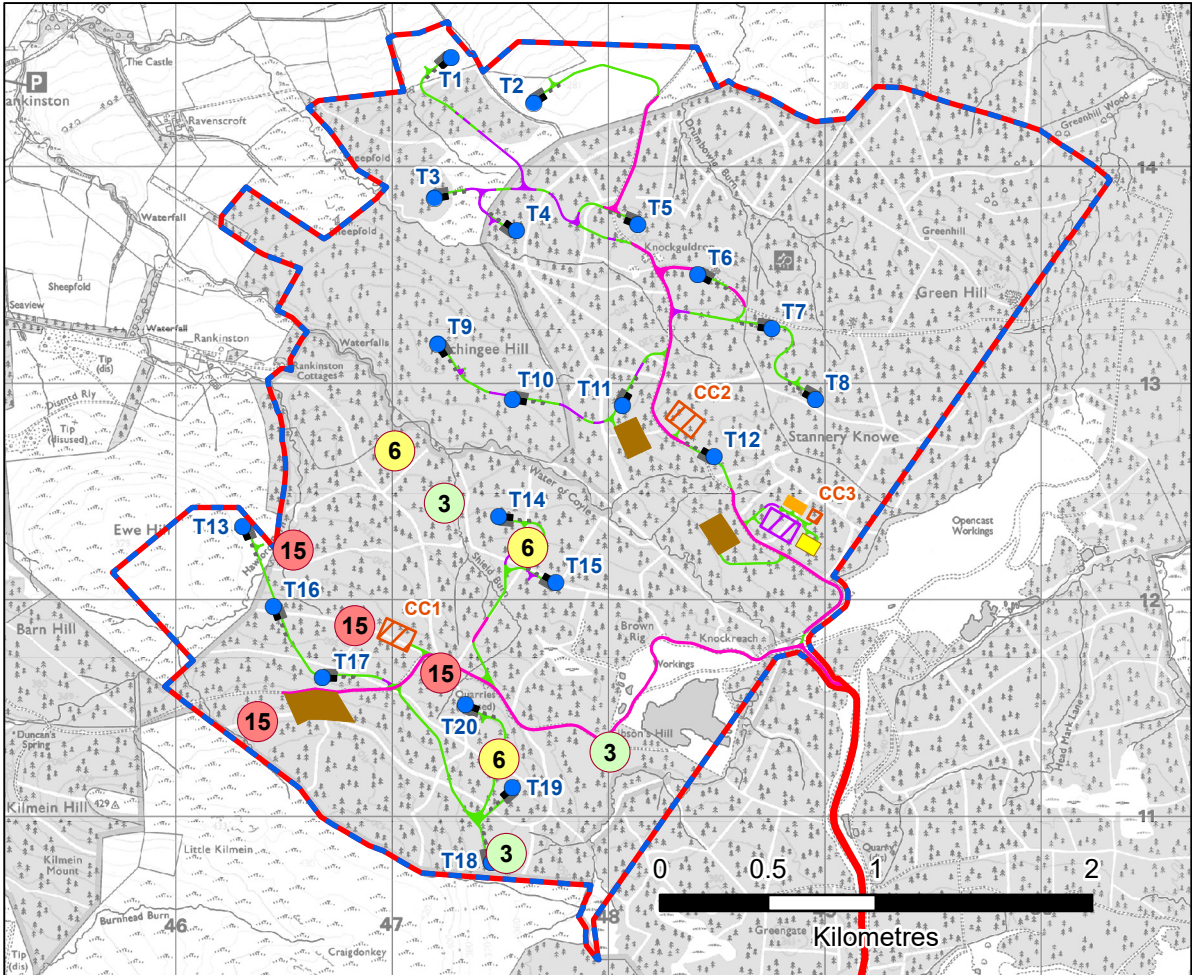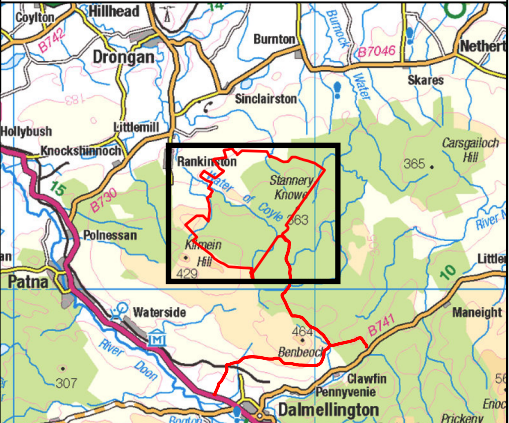

August 2021 Scale - 1:35,000 @ A3

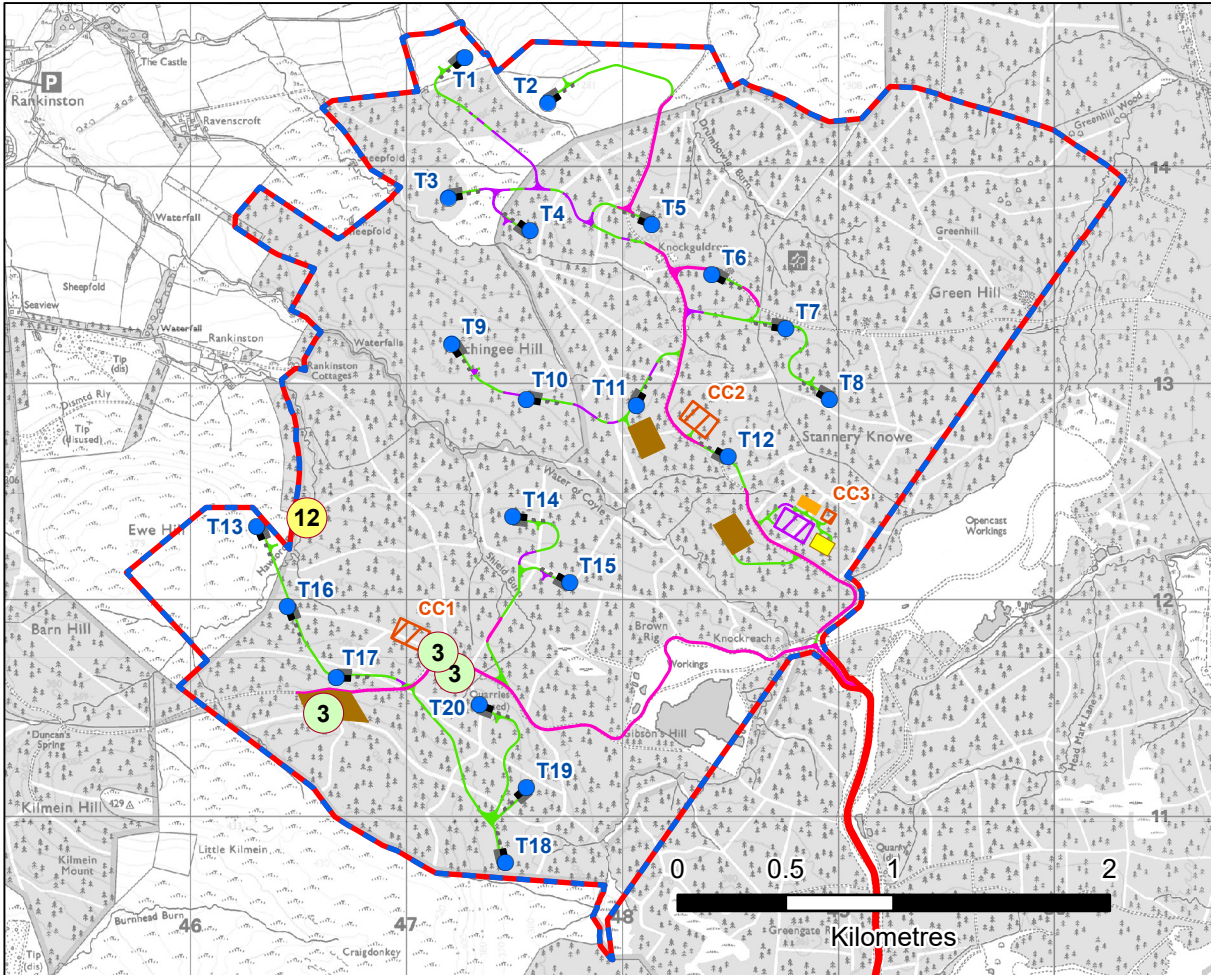

September/October 2021 Scale - 1:35,000 @ A3

BE brockwell energy

SLR

BREEZY HILL ENERGY PROJECT

ADDITIONAL INFORMATION - REVISED EIA REPORT

BAT SITE ACTIVITY 2021 - COMMON PIPISTRELLE

FIGURE 6.10

Scale 1:35,000 @ A3 Date NOVEMBER 2025